

Approval body for construction products  
and types of construction

Bautechnisches Prüfamt

An institution established by the Federal and  
Laender Governments



## European Technical Assessment

**ETA-02/0024**  
**of 13 May 2020**

English translation prepared by DIBt - Original version in German language

### General Part

Technical Assessment Body issuing the  
European Technical Assessment:

Deutsches Institut für Bautechnik

Trade name of the construction product

fischer injection system FIS V

Product family  
to which the construction product belongs

Bonded anchor for use in concrete

Manufacturer

fischerwerke GmbH & Co. KG  
Otto-Hahn-Straße 15  
79211 Denzlingen  
DEUTSCHLAND

Manufacturing plant

fischerwerke

This European Technical Assessment  
contains

34 pages including 3 annexes which form an integral part  
of this assessment

This European Technical Assessment is  
issued in accordance with Regulation (EU)  
No 305/2011, on the basis of

EAD 330499-01-0601

This version replaces

ETA-02/0024 issued on 2 January 2020

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.

## Specific Part

### 1 Technical description of the product

The "fischer injection system FIS V" is a bonded fastener consisting of a cartridge with injection mortar fischer FIS V, fischer FIS VW High Speed or fischer FIS VS Low Speed and a steel element according to Annex A5.

The steel element is placed into a drilled hole filled with injection mortar and is anchored via the bond between metal part, injection mortar and concrete.

The product description is given in Annex A.

### 2 Specification of the intended use in accordance with the applicable European Assessment Document

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the anchor of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

### 3 Performance of the product and references to the methods used for its assessment

#### 3.1 Mechanical resistance and stability (BWR 1)

| Essential characteristic                                                                 | Performance                      |
|------------------------------------------------------------------------------------------|----------------------------------|
| Characteristic resistance to tension load (static and quasi-static loading)              | See Annex B 3 to B 6, C 1 to C 8 |
| Characteristic resistance to shear load (static and quasi-static loading)                | See Annex C 1 to C 4             |
| Displacements under short-term and long-term loading                                     | See Annex C 9 and C 10           |
| Characteristic resistance and displacements for seismic performance categories C1 and C2 | See Annex C 11 to C 14           |

#### 3.2 Hygiene, health and the environment (BWR 3)

| Essential characteristic                                 | Performance             |
|----------------------------------------------------------|-------------------------|
| Content, emission and/or release of dangerous substances | No performance assessed |

**4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base**

In accordance with the European Assessment Document EAD 330499-01-0601 the applicable European legal act is: [96/582/EC].

The system to be applied is: 1

**5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document**

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited at Deutsches Institut für Bautechnik.

Issued in Berlin on 13 May 2020 by Deutsches Institut für Bautechnik


BD Dipl.-Ing. Andreas Kummerow  
Head of Department

*beglaubigt:*  
Baderschneider


Installation conditions part 1

fischer anchor rod


Pre-positioned installation

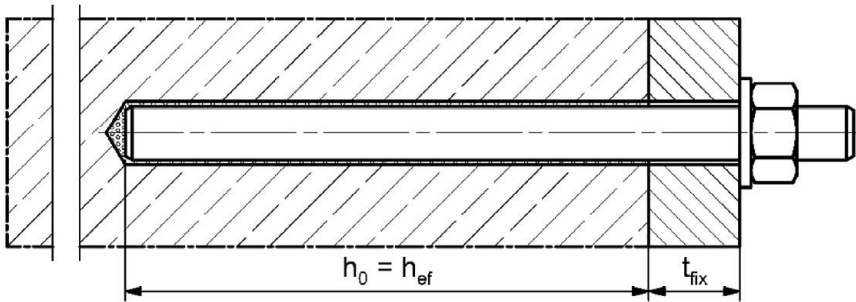

Push through installation (annular gap filled with mortar)

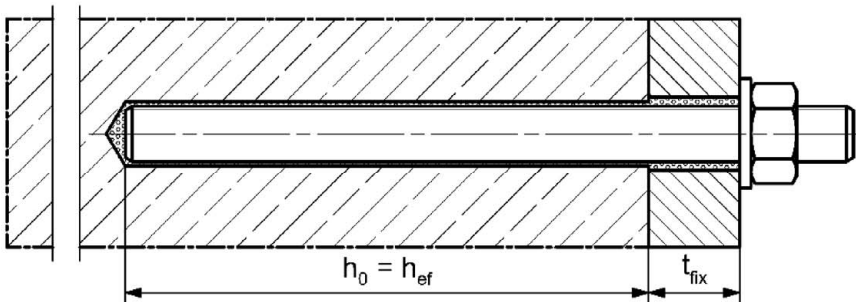

Pre-positioned or push through installation with subsequently injected fischer filling disc  
(annular gap filled with mortar)

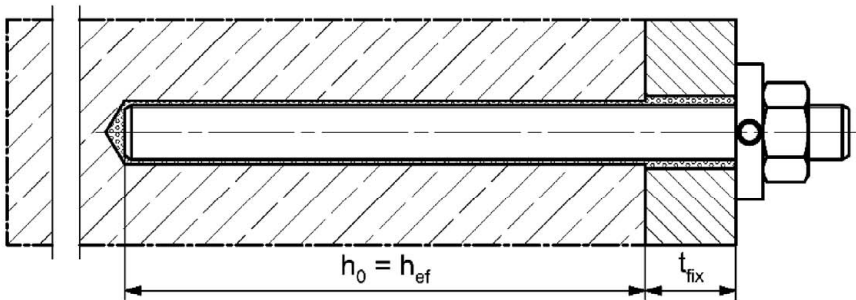

Figures not to scale

$h_0$  = drill hole depth  
 $t_{fix}$  = thickness of fixture

$h_{ef}$  = effective embedment depth

fischer injection system FIS V


Product description  
Installation conditions part 1

Annex A 1


Installation conditions part 2

fischer internal threaded anchor RG MI

Pre-positioned installation

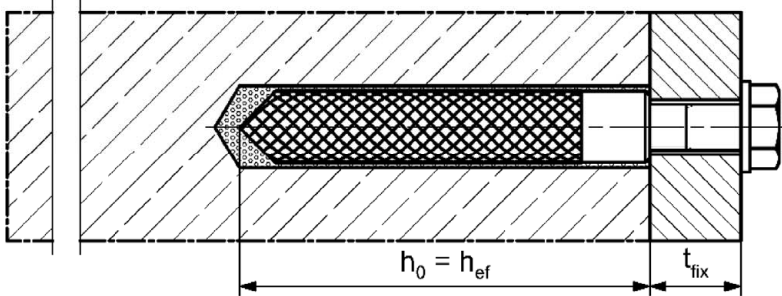

Pre-positioned installation with subsequently injected fischer filling disc (annular gap filled with mortar)

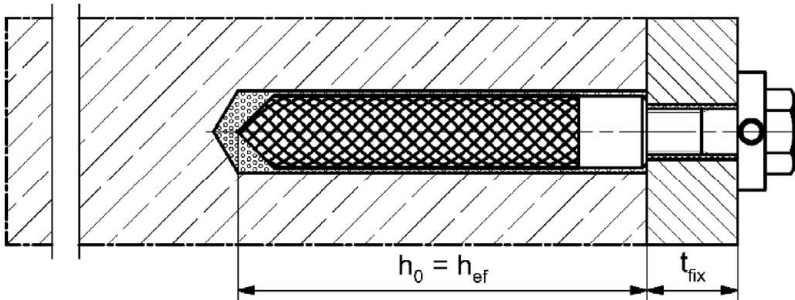

Figures not to scale

$h_0$  = drill hole depth  
 $t_{fix}$  = thickness of fixture

$h_{ef}$  = effective embedment depth


fischer injection system FIS V

Product description  
Installation conditions part 2

Annex A 2


Installation conditions part 3

Reinforcing bar

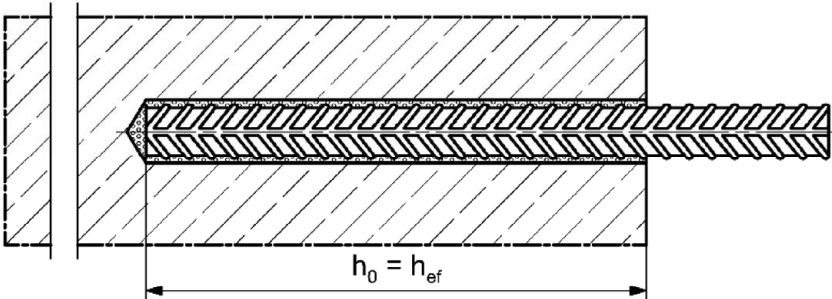


fischer rebar anchor FRA

Pre-positioned installation

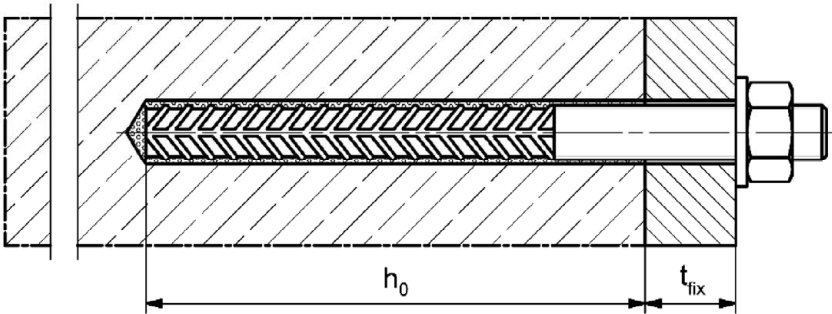

Push through installation (annular gap filled with mortar)

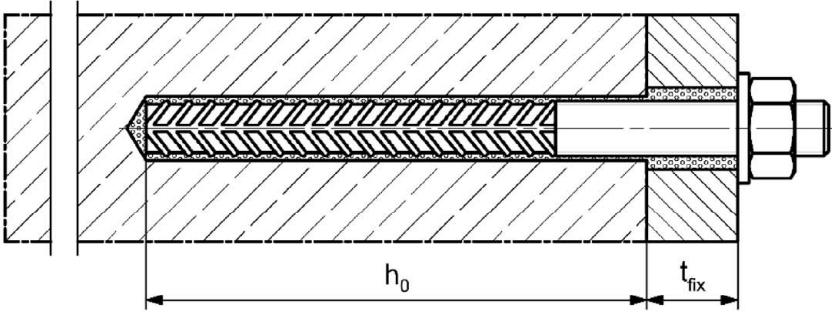

Figures not to scale

$h_0$  = drill hole depth  
 $t_{fix}$  = thickness of fixture

$h_{ef}$  = effective embedment depth


fischer injection system FIS V

Product description  
Installation conditions part 3


Annex A 3

## Overview system components part 1


**Injection cartridge (shuttle cartridge) with sealing cap; Sizes: 350 ml, 360 ml, 390 ml, 550 ml, 1100 ml, 1500 ml**

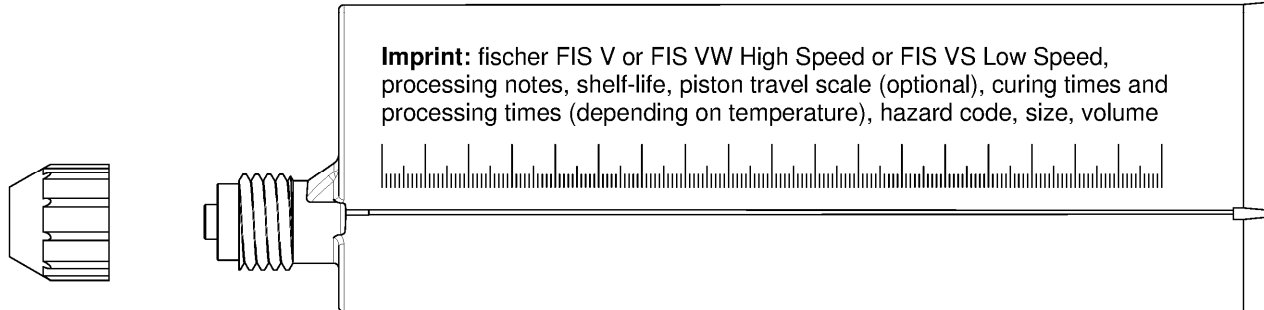


**Injection cartridge (coaxial cartridge) with sealing cap; Sizes: 100 ml, 150 ml, 300 ml, 380 ml, 400 ml, 410 ml**

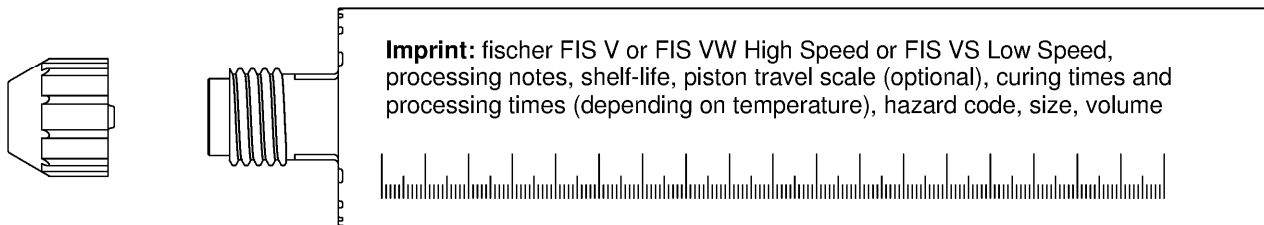

**Static mixer FIS MR Plus or UMR**

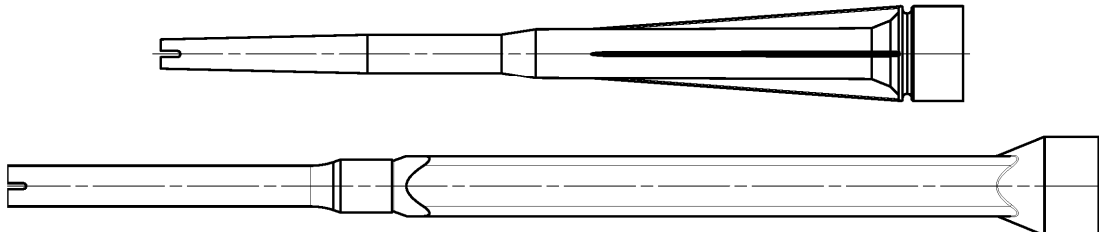

**Injection adapter and Extension tube for static mixer**



**Cleaning brush BS**



**Blow-out pump AB G or ABP**



Figures not to scale

fischer injection system FIS V

### Product description


Overview system components part 1;  
cartridges / static mixer / accessories

**Annex A 4**

## Overview system components part 2

### fischer anchor rod

Size: M6, M8, M10, M12, M16, M20, M24, M27, M30




### fischer internal threaded anchor RG MI


Size: M8, M10, M12, M16, M20



### Screw / threaded rod / washer / hexagon nut

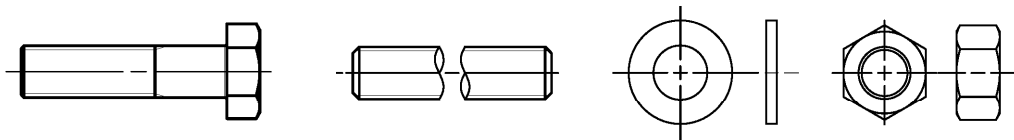

### fischer filling disc with injection adapter

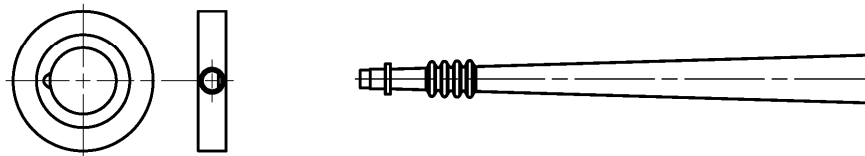

### Reinforcing bar

Nominal diameter:  $\phi 8$ ,  $\phi 10$ ,  $\phi 12$ ,  $\phi 14$ ,  $\phi 16$ ,  $\phi 20$ ,  $\phi 25$ ,  $\phi 28$



### fischer rebar anchor FRA

Size: M12, M16, M20, M24



Figures not to scale

fischer injection system FIS V

#### Product description

Overview system components part 2;  
steel components


**Annex A 5**

**Table A6.1: Materials**

| Part                             | Designation                                                                                      | Material                                                                                                                                                                                                                                                  |                                                                                                                                                                                                                                                                                                                               |                                                                                                                                                                                                                                                        |
|----------------------------------|--------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| 1                                | Injection cartridge                                                                              | Mortar, hardener, filler                                                                                                                                                                                                                                  |                                                                                                                                                                                                                                                                                                                               |                                                                                                                                                                                                                                                        |
|                                  | Steel grade                                                                                      | Steel                                                                                                                                                                                                                                                     | Stainless steel R                                                                                                                                                                                                                                                                                                             | High corrosion resistant steel HCR                                                                                                                                                                                                                     |
|                                  |                                                                                                  | zinc plated                                                                                                                                                                                                                                               | acc. to EN 10088-1:2014<br>Corrosion resistance class CRC III<br>acc. to EN 1993-1-4:2015                                                                                                                                                                                                                                     | acc. to EN 10088-1:2014<br>Corrosion resistance class CRC V<br>acc. to EN 1993-1-4:2015                                                                                                                                                                |
| 2                                | Anchor rod                                                                                       | Property class 4.8, 5.8 or 8.8;<br>EN ISO 898-1:2013<br>zinc plated ≥ 5 µm,<br>ISO 4042:2018/Zn5/An(A2K)<br>or hot dip galvanised ≥ 40 µm<br>EN ISO 10684:2004<br>f <sub>uk</sub> ≤ 1000 N/mm <sup>2</sup><br>A <sub>5</sub> > 12%<br>fracture elongation | Property class 50, 70 or 80<br>EN ISO 3506-1:2009<br>1.4401; 1.4404; 1.4578;<br>1.4571; 1.4439; 1.4362;<br>1.4062, 1.4662, 1.4462;<br>EN 10088-1:2014<br>f <sub>uk</sub> ≤ 1000 N/mm <sup>2</sup><br>A <sub>5</sub> > 12%<br>fracture elongation                                                                              | Property class 50 or 80<br>EN ISO 3506-1:2009<br>or property class 70 with<br>f <sub>yk</sub> = 560 N/mm <sup>2</sup><br>1.4565; 1.4529;<br>EN 10088-1:2014<br>f <sub>uk</sub> ≤ 1000 N/mm <sup>2</sup><br>A <sub>5</sub> > 12%<br>fracture elongation |
|                                  |                                                                                                  | Fracture elongation A <sub>5</sub> > 8 %, for applications without requirements for seismic performance category C2                                                                                                                                       |                                                                                                                                                                                                                                                                                                                               |                                                                                                                                                                                                                                                        |
| 3                                | Washer<br>ISO 7089:2000                                                                          | zinc plated ≥ 5 µm,<br>ISO 4042:2018/Zn5/An(A2K)<br>or hot dip galvanised ≥ 40 µm<br>EN ISO 10684:2004                                                                                                                                                    | 1.4401; 1.4404;<br>1.4578;1.4571;<br>1.4439; 1.4362;<br>EN 10088-1:2014                                                                                                                                                                                                                                                       | 1.4565; 1.4529;<br>EN 10088-1:2014                                                                                                                                                                                                                     |
| 4                                | Hexagon nut                                                                                      | Property class 4, 5 or 8;<br>EN ISO 898-2:2012<br>zinc plated ≥ 5 µm,<br>ISO 4042:2018/Zn5/An(A2K)<br>or hot dip galvanised ≥ 40 µm<br>EN ISO 10684:2004                                                                                                  | Property class<br>50, 70 or 80<br>EN ISO 3506-1:2009<br>1.4401; 1.4404; 1.4578;<br>1.4571; 1.4439; 1.4362;<br>EN 10088-1:2014                                                                                                                                                                                                 | Property class<br>50, 70 or 80<br>EN ISO 3506-1:2009<br>1.4565; 1.4529<br>EN 10088-1:2014                                                                                                                                                              |
| 5                                | fischer<br>internal threaded anchor<br>RG MI                                                     | Property class 5.8<br>ISO 898-1:2013<br>zinc plated ≥ 5 µm,<br>ISO 4042:2018/Zn5/An(A2K)                                                                                                                                                                  | Property class 70<br>EN ISO 3506-1:2009<br>1.4401; 1.4404; 1.4578;<br>1.4571; 1.4439; 1.4362;<br>EN 10088-1:2014                                                                                                                                                                                                              | Property class 70<br>EN ISO 3506-1:2009<br>1.4565; 1.4529;<br>EN 10088-1:2014                                                                                                                                                                          |
| 6                                | Commercial standard<br>screw or threaded rod<br>for fischer internal<br>threaded anchor<br>RG MI | Property class 5.8 or 8.8;<br>EN ISO 898-1:2013<br>zinc plated ≥ 5 µm,<br>ISO 4042:2018/Zn5/An(A2K)<br>A <sub>5</sub> > 8 %<br>fracture elongation                                                                                                        | Property class 70<br>EN ISO 3506-1:2009<br>1.4401; 1.4404; 1.4578;<br>1.4571; 1.4439; 1.4362;<br>EN 10088-1:2014<br>A <sub>5</sub> > 8 % fracture elongation                                                                                                                                                                  | Property class 70<br>EN ISO 3506-1:2009<br>1.4565; 1.4529;<br>EN 10088-1:2014<br>A <sub>5</sub> > 8 %<br>fracture elongation                                                                                                                           |
| 7                                | fischer filling disc<br>similar to DIN 6319-G                                                    | zinc plated ≥ 5 µm,<br>ISO 4042:2018/Zn5/An(A2K)<br>or hot dip galvanised ≥ 40 µm<br>EN ISO 10684:2004                                                                                                                                                    | 1.4401; 1.4404; 1.4578;<br>1.4571; 1.4439; 1.4362;<br>EN 10088-1:2014                                                                                                                                                                                                                                                         | 1.4565;1.4529;<br>EN 10088-1:2014                                                                                                                                                                                                                      |
| 8                                | Reinforcing bar<br>EN 1992-1-1:2004 and<br>AC:2010, Annex C                                      | Bars and de-coiled rods, class B or C with<br>f <sub>yk</sub> and k according to NDP or NCL of according to EN 1992-1-1/NA<br>f <sub>uk</sub> = f <sub>tk</sub> = k · f <sub>yk</sub>                                                                     |                                                                                                                                                                                                                                                                                                                               |                                                                                                                                                                                                                                                        |
| 9                                | fischer<br>rebar anchor FRA                                                                      | Rebar part:<br>Bars and de-coiled rods class B or C with f <sub>yk</sub><br>and k according to NDP or NCL of EN<br>1992-1-1:2004+AC:2010<br>f <sub>uk</sub> = f <sub>tk</sub> = k · f <sub>yk</sub>                                                       | Threaded part: Property class 70 or 80<br>EN ISO 3506-1:2009<br>1.4401, 1.4404, 1.4571, 1.4578, 1.4439,<br>1.4362, 1.4062 acc. to EN 10088-1:2014<br>Corrosion resistance class CRC III<br>acc. to EN 1993-1-4:2015<br>1.4565; 1.4529 acc. to EN 10088-1:2014<br>Corrosion resistance class CRC V<br>acc. to EN 1993-1-4:2015 |                                                                                                                                                                                                                                                        |
|                                  |                                                                                                  |                                                                                                                                                                                                                                                           |                                                                                                                                                                                                                                                                                                                               |                                                                                                                                                                                                                                                        |
| fischer injection system FIS V   |                                                                                                  |                                                                                                                                                                                                                                                           |                                                                                                                                                                                                                                                                                                                               | Annex A 6                                                                                                                                                                                                                                              |
| Product description<br>Materials |                                                                                                  |                                                                                                                                                                                                                                                           |                                                                                                                                                                                                                                                                                                                               |                                                                                                                                                                                                                                                        |

## Specifications of intended use (part 1)

**Table B1.1:** Overview use and performance categories

| Anchorages subject to                                                                                                                                                                                                                 |                        | FIS V with ...                                                                    |                                    |                                                                                    |                         |                                                                                     |                         |                                                                                     |                                          |
|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------------------------|-----------------------------------------------------------------------------------|------------------------------------|------------------------------------------------------------------------------------|-------------------------|-------------------------------------------------------------------------------------|-------------------------|-------------------------------------------------------------------------------------|------------------------------------------|
|                                                                                                                                                                                                                                       |                        | Anchor rod                                                                        |                                    | fischer internal threaded anchor RG MI                                             |                         | Reinforcing bar                                                                     |                         | fischer rebar anchor FRA                                                            |                                          |
|                                                                                                                                                                                                                                       |                        |  |                                    |  |                         |  |                         |  |                                          |
| Hammer drilling with standard drill bit                                                                                                              |                        | all sizes                                                                         |                                    |                                                                                    |                         |                                                                                     |                         |                                                                                     |                                          |
| Hammer drilling with hollow drill bit (fischer "FHD", Heller "Duster Expert"; Bosch „Speed Clean“; Hilti "TE-CD, TE-YD"), DreBo D-Plus, DreBo D-Max  |                        | Nominal drill bit diameter (d <sub>0</sub> )<br>12 mm to 35 mm                    |                                    |                                                                                    |                         |                                                                                     |                         |                                                                                     |                                          |
| Static and quasi static load, in                                                                                                                                                                                                      | uncracked concrete     | all sizes                                                                         | Tables:<br>C1.1<br>C4.1            | all sizes                                                                          | Tables:<br>C2.1<br>C4.1 | all sizes                                                                           | Tables:<br>C3.1<br>C4.1 | all sizes                                                                           | Tables:<br>C3.2<br>C4.1<br>C8.1<br>C10.2 |
|                                                                                                                                                                                                                                       | cracked concrete       | M8 to M30                                                                         | C5.1<br>C9.1                       | ..2)                                                                               | C6.1<br>C9.2            | φ 10 to φ 28                                                                        | C7.1<br>C10.1           |                                                                                     |                                          |
| Seismic performance category (only hammer drilling with standard / hollow drill bits)                                                                                                                                                 | C1 <sup>1)</sup>       | M10 to M30                                                                        | Tables:<br>C11.1<br>C12.1<br>C13.1 | ..2)                                                                               |                         | ..2)                                                                                |                         | ..2)                                                                                |                                          |
|                                                                                                                                                                                                                                       | C2 <sup>1)</sup>       | M12<br>M16<br>M20<br>M24                                                          | Tables:<br>C11.1<br>C12.1<br>C14.1 |                                                                                    |                         |                                                                                     |                         |                                                                                     |                                          |
| Use category                                                                                                                                                                                                                          | I1 dry or wet concrete | all sizes                                                                         |                                    |                                                                                    |                         |                                                                                     |                         |                                                                                     |                                          |
|                                                                                                                                                                                                                                       | I2 water filled hole   | M 12 to M 30                                                                      |                                    | all sizes                                                                          |                         | ..2)                                                                                |                         | ..2)                                                                                |                                          |
| Installation direction                                                                                                                                                                                                                |                        | D3 (downward and horizontal and upwards (e.g. overhead) installation)             |                                    |                                                                                    |                         |                                                                                     |                         |                                                                                     |                                          |
| Installation temperature                                                                                                                                                                                                              |                        | T <sub>i,min</sub> = -10 °C to T <sub>i,max</sub> = +40 °C                        |                                    |                                                                                    |                         |                                                                                     |                         |                                                                                     |                                          |
| In-service temperature                                                                                                                                                                                                                | Temperature range I    | -40 °C to +80 °C                                                                  |                                    | (max. short term temperature +80 °C;<br>max. long term temperature +50 °C)         |                         |                                                                                     |                         |                                                                                     |                                          |
|                                                                                                                                                                                                                                       | Temperature range II   | -40 °C to +120 °C                                                                 |                                    | (max. short term temperature +120 °C;<br>max. long term temperature +72 °C)        |                         |                                                                                     |                         |                                                                                     |                                          |
| <sup>1)</sup> Not for FIS VW High Speed and FIS VS Low Speed<br><sup>2)</sup> No performance assessed                                                                                                                                 |                        |                                                                                   |                                    |                                                                                    |                         |                                                                                     |                         |                                                                                     |                                          |
| fischer injection system FIS V                                                                                                                                                                                                        |                        |                                                                                   |                                    |                                                                                    |                         |                                                                                     | Annex B 1               |                                                                                     |                                          |
| Intended use<br>Specifications (part 1)                                                                                                                                                                                               |                        |                                                                                   |                                    |                                                                                    |                         |                                                                                     |                         |                                                                                     |                                          |

## Specifications of intended use (part 2)

### Base materials:

- Compacted reinforced or unreinforced normal weight concrete without fibres of strength classes C20/25 to C50/60 according to EN 206:2013+A1:2016

### Use conditions (Environmental conditions):

- Structures subject to dry internal conditions (zinc coated steel, stainless steel or high corrosion resistant steel).
- For all other conditions according to EN1993-1-4:2015 corresponding to corrosion resistance classes to Annex A 6 table A6.1.

### Design:

- Anchorages have to be designed by a responsible engineer with experience of concrete anchor design.
- Verifiable calculation notes and drawings are to be prepared taking account of the loads to be anchored. The position of the anchor is indicated on the design drawings (e. g. position of the anchor relative to reinforcement or to supports, etc.).
- Anchorages are designed in accordance with:  
EN 1992-4:2018 and EOTA Technical Report TR 055, Edition February 2018.

### Installation:

- Anchor installation is to be carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site
- In case of aborted hole: The hole shall be filled with mortar
- Anchorage depth should be marked and adhered to on installation
- Overhead installation is allowed

fischer injection system FIS V


**Intended use**  
Specifications (part 2)

**Annex B 2**

**Table B3.1: Installation parameters for anchor rods**

| Anchor rods                                   |                             | Thread | M6                       | M8  | M10 | M12 | M16             | M20 | M24 | M27 | M30 |
|-----------------------------------------------|-----------------------------|--------|--------------------------|-----|-----|-----|-----------------|-----|-----|-----|-----|
| Width across flats                            | SW                          | [mm]   | 10                       | 13  | 17  | 19  | 24              | 30  | 36  | 41  | 46  |
| Nominal drill hole diameter                   | $d_0$                       |        | 8                        | 10  | 12  | 14  | 18              | 24  | 28  | 30  | 35  |
| Drill hole depth                              | $h_0$                       |        | $h_0 = h_{ef}$           |     |     |     |                 |     |     |     |     |
| Effective embedment depth                     | $h_{ef, min}$               |        | 50                       | 60  | 60  | 70  | 80              | 90  | 96  | 108 | 120 |
|                                               | $h_{ef, max}$               |        | 72                       | 160 | 200 | 240 | 320             | 400 | 480 | 540 | 600 |
| Minimum spacing and minimum edge distance     | $s_{min} = c_{min}$         |        | 40                       | 40  | 45  | 55  | 65              | 85  | 105 | 125 | 140 |
| Diameter of the clearance hole of the fixture | pre-positioned installation |        | 7                        | 9   | 12  | 14  | 18              | 22  | 26  | 30  | 33  |
|                                               | push through installation   |        | 9                        | 12  | 14  | 16  | 20              | 26  | 30  | 33  | 40  |
| Minimum thickness of concrete member          | $h_{min}$                   |        | $h_{ef} + 30 (\geq 100)$ |     |     |     | $h_{ef} + 2d_0$ |     |     |     |     |
| Maximum installation torque                   | $\max T_{inst}$             | [Nm]   | 5                        | 10  | 20  | 40  | 60              | 120 | 150 | 200 | 300 |

**fischer anchor rod**

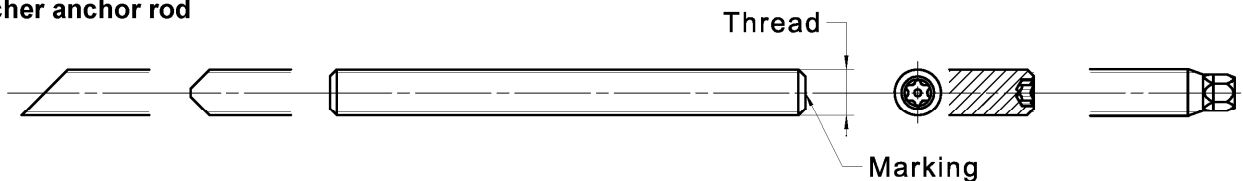


**Marking (on random place) fischer anchor rod:**

|                                                        |        |                                                        |   |
|--------------------------------------------------------|--------|--------------------------------------------------------|---|
| Steel zinc plated PC <sup>1)</sup> 8.8                 | • or + | Steel hot-dip PC <sup>1)</sup> 8.8                     | • |
| High corrosion resistant steel HCR PC <sup>1)</sup> 50 | •      | High corrosion resistant steel HCR PC <sup>1)</sup> 70 | - |
| High corrosion resistant steel HCR PC <sup>1)</sup> 80 | (      | Stainless steel R property class 50                    | ~ |
| Stainless steel R property class 80                    | *      |                                                        |   |

Alternatively: Colour coding according to DIN 976-1: 2016

<sup>1)</sup> PC = property class

**Installation conditions:**

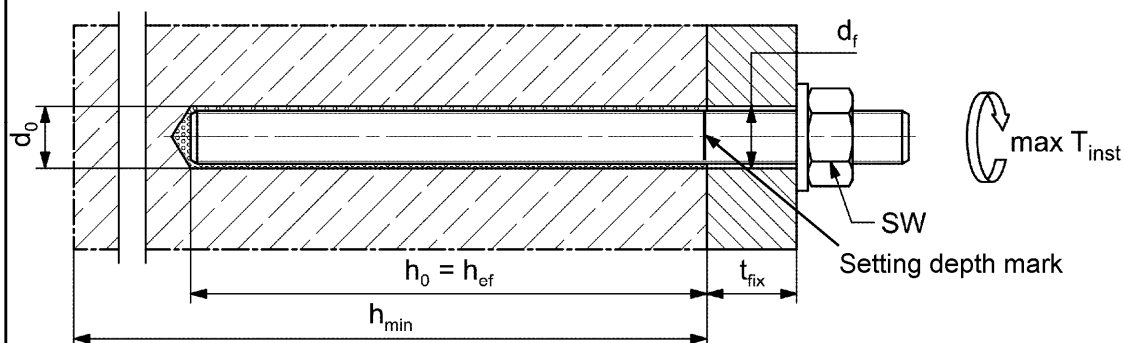

**Commercial standard threaded rods, washers and hexagon nuts may also be used if the following requirements are fulfilled**

- Materials, dimensions and mechanical properties according to Annex A 6, Table A6.1
- Inspection certificate 3.1 according to EN 10204:2004, the documents have to be stored
- Setting depth is marked

Figures not to scale

fischer injection system FIS V



**Intended use**  
Installation parameters anchor rods

**Annex B 3**

**Table B4.1:** Installation parameters for **fischer internal threaded anchors RG MI**

| Internal threaded anchors RG MI                 |                             | Thread | M8                   | M10 | M12 | M16 | M20 |
|-------------------------------------------------|-----------------------------|--------|----------------------|-----|-----|-----|-----|
| Diameter of anchor                              | $d_{nom} = d_H$             | [mm]   | 12                   | 16  | 18  | 22  | 28  |
| Nominal drill hole diameter                     | $d_0$                       |        | 14                   | 18  | 20  | 24  | 32  |
| Drill hole depth                                | $h_0$                       |        | $h_0 = h_{ef} = L_H$ |     |     |     |     |
| Effective embedment depth<br>( $h_{ef} = L_H$ ) | $h_{ef}$                    |        | 90                   | 90  | 125 | 160 | 200 |
| Minimum spacing and<br>minimum edge distance    | $S_{min}$<br>=<br>$C_{min}$ |        | 55                   | 65  | 75  | 95  | 125 |
| Diameter of clearance hole in<br>the fixture    | $d_f$                       |        | 9                    | 12  | 14  | 18  | 22  |
| Minimum thickness<br>of concrete member         | $h_{min}$                   |        | 120                  | 125 | 165 | 205 | 260 |
| Maximum screw-in depth                          | $l_{E,max}$                 |        | 18                   | 23  | 26  | 35  | 45  |
| Minimum screw-in depth                          | $l_{E,min}$                 |        | 8                    | 10  | 12  | 16  | 20  |
| Maximum installation torque                     | $\max T_{inst}$             | [Nm]   | 10                   | 20  | 40  | 80  | 120 |


**fischer internal threaded anchor RG MI**

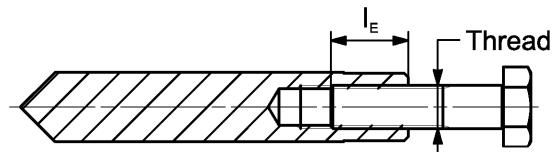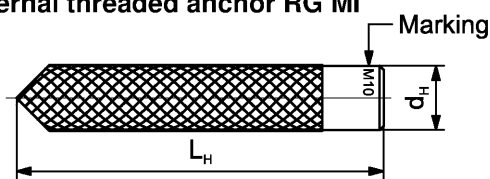

**Marking:** Anchor size e. g.: **M10**  
Stainless steel → additional **R**; e.g.: **M10 R**  
High corrosion resistant steel → additional **HCR**; e.g.: **M10 HCR**

Retaining bolt or threaded rods (including nut and washer) must comply with the appropriate material and strength class of Annex A 6, Table A6.1

**Installation conditions:**

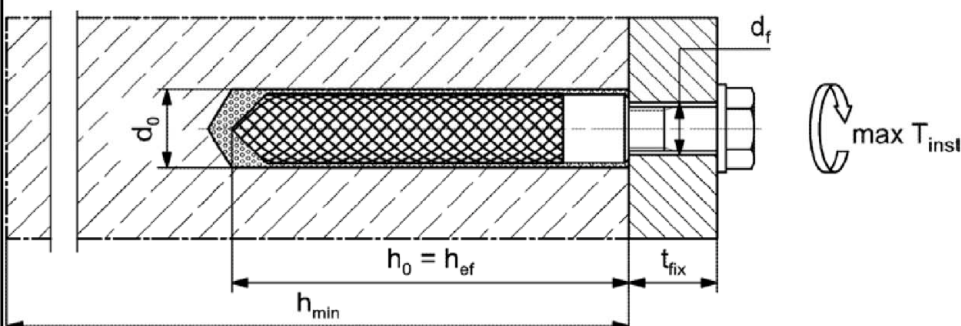

Figures not to scale

fischer injection system FIS V

**Intended use**  
Installation parameters internal threaded anchors RG MI

**Annex B 4**

**Table B5.1:** Installation parameters for reinforcing bars

| Nominal diameter of the bar $\phi$                            |      | 8 <sup>1)</sup>                 | 10 <sup>1)</sup> | 12 <sup>1)</sup> | 14              | 16  | 20  | 25  | 28  |
|---------------------------------------------------------------|------|---------------------------------|------------------|------------------|-----------------|-----|-----|-----|-----|
| Nominal drill hole diameter $d_0$                             |      | 10   12                         | 12   14          | 14   16          | 18              | 20  | 25  | 30  | 35  |
| Drill hole depth $h_0$                                        |      | $h_0 = h_{ef}$                  |                  |                  |                 |     |     |     |     |
| Effective embedment depth $h_{ef,min}$                        |      | 60                              | 60               | 70               | 75              | 80  | 90  | 100 | 112 |
| $h_{ef,max}$                                                  |      | 160                             | 200              | 240              | 280             | 320 | 400 | 500 | 560 |
| Minimum spacing and minimum edge distance $s_{min} = c_{min}$ | [mm] | 40                              | 45               | 55               | 60              | 65  | 85  | 110 | 130 |
| Minimum thickness of concrete member $h_{min}$                |      | $h_{ef} + 30$<br>( $\geq 100$ ) |                  |                  | $h_{ef} + 2d_0$ |     |     |     |     |


<sup>1)</sup> Both drill hole diameters can be used

#### Reinforcing bar



- The minimum value of related rib area  $f_{R,min}$  must fulfil the requirements of EN 1992-1-1:2004+AC:2010
- The rib height must be within the range:  $0,05 \cdot \phi \leq h_{rib} \leq 0,07 \cdot \phi$   
( $\phi$  = Nominal diameter of the bar,  $h_{rib}$  = rib height)

#### Installation conditions:

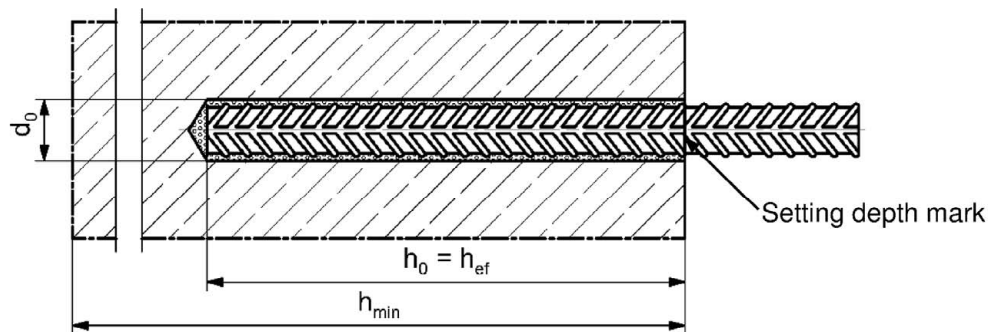

Figures not to scale

fischer injection system FIS V

**Intended use**  
Installation parameters reinforcing bars


**Annex B 5**

**Table B6.1:** Installation parameters for **fischer rebar anchor FRA**

| Rebar anchor FRA                          |                                     | Thread | M12 <sup>1)</sup> |              | M16 | M20 | M24 |
|-------------------------------------------|-------------------------------------|--------|-------------------|--------------|-----|-----|-----|
| Nominal diameter of the bar               | $\phi$                              | [mm]   | 12                |              | 16  | 20  | 25  |
| Width across flats                        | SW                                  |        | 19                |              | 24  | 30  | 36  |
| Nominal drill hole diameter               | $d_0$                               |        | 14                | 16           | 20  | 25  | 30  |
| Drill hole depth                          | $h_0$                               |        | $h_{ef} + l_e$    |              |     |     |     |
| Effective embedment depth                 | $h_{ef,min}$                        |        | 70                |              | 80  | 90  | 96  |
|                                           | $h_{ef,max}$                        |        | 140               |              | 220 | 300 | 380 |
| Distance concrete surface to welded joint | $l_e$                               |        | 100               |              |     |     |     |
| Minimum spacing and minimum edge distance | $s_{min} = c_{min}$                 |        | 55                |              | 65  | 85  | 105 |
| Diameter of clearance hole in the fixture | pre-positioned anchorage $\leq d_f$ |        | 14                |              | 18  | 22  | 26  |
|                                           | push through anchorage $\leq d_f$   |        | 18                |              | 22  | 26  | 32  |
| Minimum thickness of concrete member      | $h_{min}$                           |        | $h_0 + 30$        | $h_0 + 2d_0$ |     |     |     |
| Maximum installation torque               | $\max T_{inst}$                     | [Nm]   | 40                |              | 60  | 120 | 150 |

<sup>1)</sup> Both drill hole diameters can be used

**fischer rebar anchor FRA**

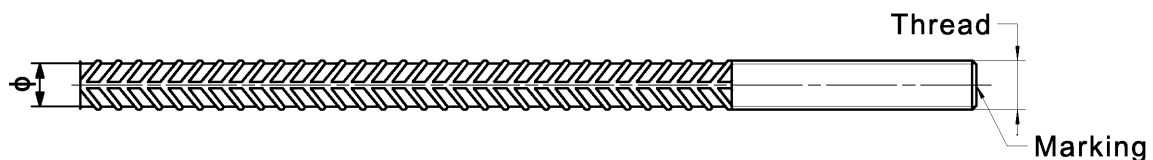


Marking frontal e. g:

 FRA (for stainless steel);

 FRA HCR (for high corrosion resistant steel)

**Installation conditions:**

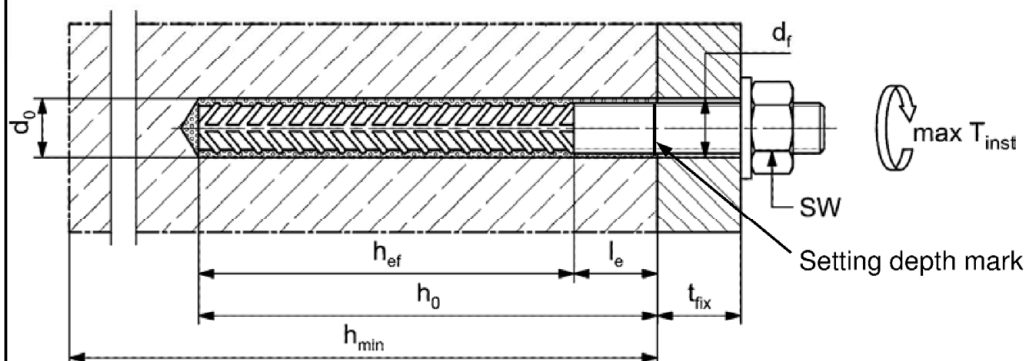

Figures not to scale

fischer injection system FIS V

**Intended use**  
Installation parameters rebar anchor FRA

**Annex B 6**

**Table B7.1:** Parameters of the **cleaning brush BS** (steel brush with steel bristles)

The size of the cleaning brush refers to the drill hole diameter

|                             |       |      |   |    |    |    |    |    |    |    |    |    |    |    |
|-----------------------------|-------|------|---|----|----|----|----|----|----|----|----|----|----|----|
| Nominal drill hole diameter | $d_0$ |      | 8 | 10 | 12 | 14 | 16 | 18 | 20 | 24 | 25 | 28 | 30 | 35 |
| Steel brush diameter        | $d_b$ | [mm] | 9 | 11 | 14 | 16 | 20 | 25 | 26 | 27 | 30 | 40 |    |    |



**Table B7.2** **Maximum processing** time of the mortar and **minimum curing** time  
(During the curing time of the mortar the concrete temperature may not fall below the listed minimum temperature)

| Temperature at anchoring base [°C] | Maximum processing time<br>$t_{work}$ |        |                     | Minimum curing time <sup>1)</sup><br>$t_{cure}$ |        |                     |
|------------------------------------|---------------------------------------|--------|---------------------|-------------------------------------------------|--------|---------------------|
|                                    | FIS VW<br>High Speed                  | FIS V  | FIS VS<br>Low Speed | FIS VW<br>High Speed                            | FIS V  | FIS VS<br>Low Speed |
| -10 to -5 <sup>2)</sup>            | -                                     | -      | -                   | 12 h                                            | -      | -                   |
| > -5 to 0 <sup>2)</sup>            | 5 min                                 | -      | -                   | 3 h                                             | 24 h   | -                   |
| > 0 to 5 <sup>2)</sup>             | 5 min                                 | 13 min | -                   | 3 h                                             | 3 h    | 6 h                 |
| > 5 to 10                          | 3 min                                 | 9 min  | 20 min              | 50 min                                          | 90 min | 3 h                 |
| > 10 to 20                         | 1 min                                 | 5 min  | 10 min              | 30 min                                          | 60 min | 2 h                 |
| > 20 to 30                         | -                                     | 4 min  | 6 min               | -                                               | 45 min | 60 min              |
| > 30 to 40                         | -                                     | 2 min  | 4 min               | -                                               | 35 min | 30 min              |

<sup>1)</sup> In wet concrete or water filled holes the curing times must be doubled

<sup>2)</sup> Minimal cartridge temperature +5°C

fischer injection system FIS V







**Intended use**

Cleaning brush (steel brush)  
Processing time and curing time

**Annex B 7**



## Installation instructions part 1

### Drilling and cleaning the hole (hammer drilling with standard drill bit)
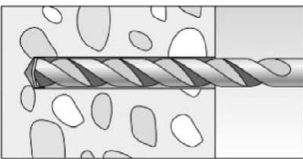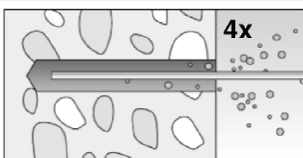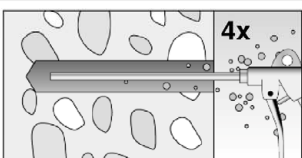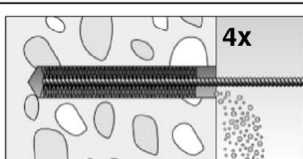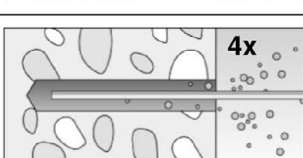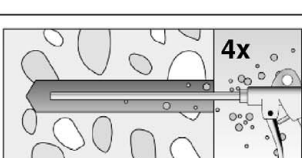
|   |                                                                                    |                                                                                                                             |                                                                                     |                                                                                                                                      |
|---|------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------|
| 1 |   | Drill the hole.<br>Nominal drill hole diameter $d_0$ and drill hole depth $h_0$<br>see <b>tables B3.1, B4.1, B5.1, B6.1</b> |                                                                                     |                                                                                                                                      |
| 2 |   | Clean the drill hole:<br>For $h_{ef} \leq 12d$ and<br>$d_0 < 18$ mm<br>blow out the hole four<br>times by hand              |   | For $h_{ef} > 12d$ and / or<br>$d_0 \geq 18$ mm blow out<br>the hole four times with<br>oil-free compressed air<br>( $p \geq 6$ bar) |
| 3 |   | Brush the drill hole four times. For deep holes use an extension.<br>Corresponding brushes see <b>table B7.1</b>            |                                                                                     |                                                                                                                                      |
| 4 |  | Clean the drill hole:<br>For $h_{ef} \leq 12d$ and<br>$d_0 < 18$ mm<br>blow out the hole four<br>times by hand              |  | For $h_{ef} > 12d$ and / or<br>$d_0 \geq 18$ mm blow out<br>the hole four times with<br>oil-free compressed air<br>( $p \geq 6$ bar) |

Go to step 5

### Drilling and cleaning the hole (hammer drilling with hollow drill bit)
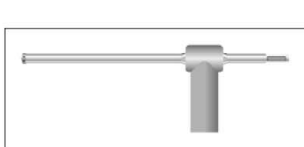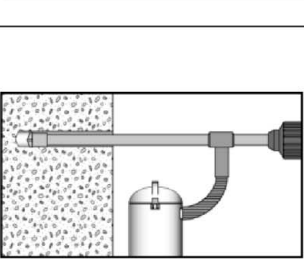
|   |                                                                                     |                                                                                                                                                                                                                                                                                                                                                                                                                                             |
|---|-------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| 1 |  | Check a suitable hollow drill (see <b>table B1.1</b> )<br>for correct operation of the dust extraction                                                                                                                                                                                                                                                                                                                                      |
| 2 |  | Use a suitable dust extraction system, e. g.<br>fischer FVC 35 M or a comparable dust extraction system<br>with equivalent performance data<br><br>Drill the hole with hollow drill bit. The dust extraction system has to extract the<br>drill dust nonstop during the drilling process and must be adjusted to<br>maximum power. Nominal drill hole diameter $d_0$ and drill hole depth $h_0$<br>see <b>tables B3.1, B4.1, B5.1, B6.1</b> |

Go to step 5




fischer injection system FIS V

**Intended use**  
Installation instructions part 1

**Annex B 8**




## Installation instructions part 2

### Preparing the cartridge

|   |                                                                                   |                                                                                                                                                                                                                             |
|---|-----------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| 5 |  | <p>Remove the sealing cap</p> <p>Screw on the static mixer<br/>(the spiral in the static mixer must be clearly visible)</p>                                                                                                 |
| 6 |  |  <p>Place the cartridge into the dispenser</p>                                                                                             |
| 7 |  |  <p>Extrude approximately 10 cm of material out until the resin is evenly grey in colour. Do not use mortar that is not uniformly grey</p> |

Go to step 8

### Injection of the mortar
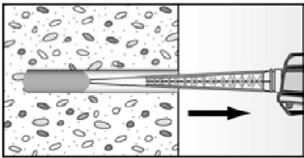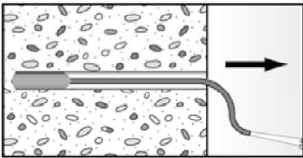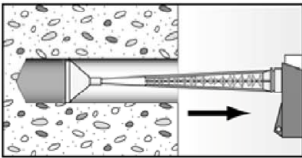
|   |                                                                                                                                                                                                            |                                                                                                                                                               |                                                                                                                                                                                                                                                |
|---|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| 8 |  <p>Fill approximately 2/3 of the drill hole with mortar. Always begin from the bottom of the hole and avoid bubbles</p> |  <p>For drill hole depth <math>\geq 150</math> mm use an extension tube</p> |  <p>For overhead installation, deep holes (<math>h_0 &gt; 250</math> mm) or drill hole diameter (<math>d_0 \geq 40</math> mm) use an injection adapter</p> |
|---|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|

Go to step 9






fischer injection system FIS V

**Intended use**  
Installation instructions part 2



**Annex B 9**

### Installation instructions part 3

#### Installation of anchor rods or fischer internal threaded anchors RG MI
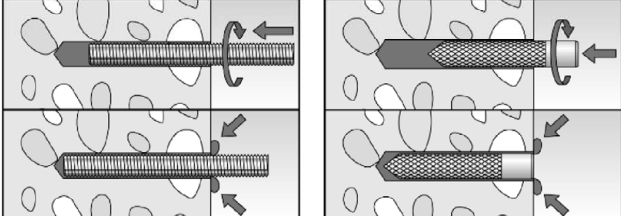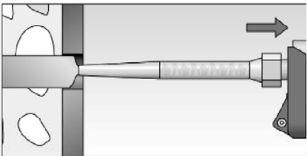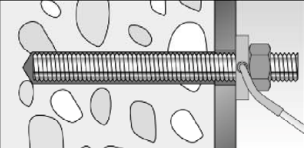
|        |                                                                                                                                                                                                                   |                                                                                                                                                                                                                                                                                                                                                                                                    |
|--------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| 9      |                                                                                                                                  | <p>Only use clean and oil-free metal parts. Mark the setting depth of the metal part. Push the anchor rod or fischer internal threaded RG MI anchor down to the bottom of the hole, turning it slightly while doing so. After inserting the metal parts, excess mortar must be emerged around the anchor element.</p>                                                                              |
|        |  <p>For overhead installations support the metal part with wedges (e.g. fischer centering wedges) or fischer overhead clips.</p> |  <p>For push through installation fill the annular gap with mortar</p>                                                                                                                                                                                                                                           |
| 10     |  <p>Wait for the specified curing time<br/><math>t_{cure}</math><br/>see <b>table B7.2</b></p>                                   | <p>11</p>  <p>Mounting the fixture<br/><math>\max T_{inst}</math> see <b>tables B3.1 and B4.1</b></p>                                                                                                                                                                                                           |
| Option |                                                                                                                                | <p>After the minimum curing time is reached, the gap between metal part and fixture (annular clearance) may be filled with mortar via the fischer filling disc. Compressive strength <math>\geq 50 \text{ N/mm}^2</math> (e.g. fischer injection mortars FIS HB, FIS SB, FIS V, FIS EM Plus). ATTENTION: Using fischer filling disc reduces <math>t_{fix}</math> (usable length of the anchor)</p> |

#### Installation reinforcing bars and fischer rebar anchor FRA
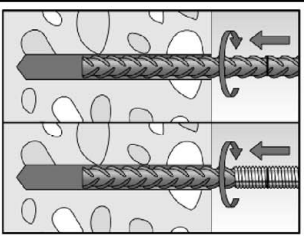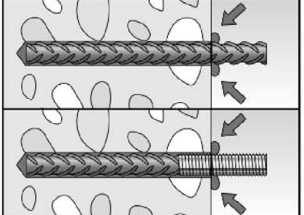
|    |                                                                                                                                                                           |                                                                                                                                                                                                                       |
|----|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| 9  |                                                                                        | <p>Only use clean and oil-free reinforcing bars or fischer FRA. Mark the setting depth. Turn while using force to push the reinforcement bar or the fischer FRA into the filled hole up to the setting depth mark</p> |
|    |                                                                                        | <p>When the setting depth mark is reached, excess mortar must be emerged from the mouth of the drill hole.</p>                                                                                                        |
| 10 |  <p>Wait for the specified curing time <math>t_{cure}</math> see <b>table B7.2</b></p> | <p>11</p>  <p>Mounting the fixture<br/><math>\max T_{inst}</math> see <b>table B6.1</b></p>                                       |

fischer injection system FIS V

**Intended use**  
Installation instructions part 3

**Annex B 10**

**Table C1.1: Characteristic values for steel failure under tension / shear load of fischer anchor rods and standard threaded rods**

| Anchor rod / standard threaded rod                                                                                                                                                          |                                                          |                |       | M6   | M8                        | M10    | M12    | M16 | M20       | M24 | M27 | M30  |      |
|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|----------------------------------------------------------|----------------|-------|------|---------------------------|--------|--------|-----|-----------|-----|-----|------|------|
| Bearing capacity under tension load, steel failure <sup>3)</sup>                                                                                                                            |                                                          |                |       |      |                           |        |        |     |           |     |     |      |      |
| Characteristic resistance $N_{Rk,s}$                                                                                                                                                        | Steel zinc plated                                        | Property class | 4.8   | [kN] | 8                         | 15(13) | 23(21) | 33  | 63        | 98  | 141 | 184  | 224  |
|                                                                                                                                                                                             |                                                          |                | 5.8   |      | 10                        | 19(17) | 29(27) | 43  | 79        | 123 | 177 | 230  | 281  |
|                                                                                                                                                                                             |                                                          |                | 8.8   |      | 16                        | 29(27) | 47(43) | 68  | 126       | 196 | 282 | 368  | 449  |
|                                                                                                                                                                                             | Stainless steel R and high corrosion resistant steel HCR |                | 50    |      | 10                        | 19     | 29     | 43  | 79        | 123 | 177 | 230  | 281  |
|                                                                                                                                                                                             |                                                          |                | 70    |      | 14                        | 26     | 41     | 59  | 110       | 172 | 247 | 322  | 393  |
|                                                                                                                                                                                             |                                                          |                | 80    |      | 16                        | 30     | 47     | 68  | 126       | 196 | 282 | 368  | 449  |
| Partial factors <sup>1)</sup>                                                                                                                                                               |                                                          |                |       |      |                           |        |        |     |           |     |     |      |      |
| Partial factor $\gamma_{Ms,N}$                                                                                                                                                              | Steel zinc plated                                        | Property class | 4.8   | [-]  | 1,50                      |        |        |     |           |     |     |      |      |
|                                                                                                                                                                                             |                                                          |                | 5.8   |      | 1,50                      |        |        |     |           |     |     |      |      |
|                                                                                                                                                                                             |                                                          |                | 8.8   |      | 1,50                      |        |        |     |           |     |     |      |      |
|                                                                                                                                                                                             | Stainless steel R and high corrosion resistant steel HCR |                | 50    |      | 2,86                      |        |        |     |           |     |     |      |      |
|                                                                                                                                                                                             |                                                          |                | 70    |      | 1,50 <sup>2)</sup> / 1,87 |        |        |     |           |     |     |      |      |
|                                                                                                                                                                                             |                                                          |                | 80    |      | 1,60                      |        |        |     |           |     |     |      |      |
| Bearing capacity under shear load, steel failure <sup>3)</sup>                                                                                                                              |                                                          |                |       |      |                           |        |        |     |           |     |     |      |      |
| without lever arm                                                                                                                                                                           |                                                          |                |       |      |                           |        |        |     |           |     |     |      |      |
| Characteristic resistance $V_{Rk,s}^0$                                                                                                                                                      | Steel zinc plated                                        | Property class | 4.8   | [kN] | 4                         | 9(8)   | 14(13) | 20  | 38        | 59  | 85  | 110  | 135  |
|                                                                                                                                                                                             |                                                          |                | 5.8   |      | 6                         | 11(10) | 17(16) | 25  | 47        | 74  | 106 | 138  | 168  |
|                                                                                                                                                                                             |                                                          |                | 8.8   |      | 8                         | 15(13) | 23(21) | 34  | 63        | 98  | 141 | 184  | 225  |
|                                                                                                                                                                                             | Stainless steel R and high corrosion resistant steel HCR |                | 50    |      | 5                         | 9      | 15     | 21  | 39        | 61  | 89  | 115  | 141  |
|                                                                                                                                                                                             |                                                          |                | 70    |      | 7                         | 13     | 20     | 30  | 55        | 86  | 124 | 161  | 197  |
|                                                                                                                                                                                             |                                                          |                | 80    |      | 8                         | 15     | 23     | 34  | 63        | 98  | 141 | 184  | 225  |
| Ductility factor                                                                                                                                                                            |                                                          |                | $k_7$ | [-]  | 1,0                       |        |        |     |           |     |     |      |      |
| with lever arm                                                                                                                                                                              |                                                          |                |       |      |                           |        |        |     |           |     |     |      |      |
| Charact. resistance $M_{Rk,s}^0$                                                                                                                                                            | Steel zinc plated                                        | Property class | 4.8   | [Nm] | 6                         | 15(13) | 30(27) | 52  | 133       | 259 | 448 | 665  | 899  |
|                                                                                                                                                                                             |                                                          |                | 5.8   |      | 7                         | 19(16) | 37(33) | 65  | 166       | 324 | 560 | 833  | 1123 |
|                                                                                                                                                                                             |                                                          |                | 8.8   |      | 12                        | 30(26) | 60(53) | 105 | 266       | 519 | 896 | 1333 | 1797 |
|                                                                                                                                                                                             | Stainless steel R and high corrosion resistant steel HCR |                | 50    |      | 7                         | 19     | 37     | 65  | 166       | 324 | 560 | 833  | 1123 |
|                                                                                                                                                                                             |                                                          |                | 70    |      | 10                        | 26     | 52     | 92  | 232       | 454 | 784 | 1167 | 1573 |
|                                                                                                                                                                                             |                                                          |                | 80    |      | 12                        | 30     | 60     | 105 | 266       | 519 | 896 | 1333 | 1797 |
| Partial factors <sup>1)</sup>                                                                                                                                                               |                                                          |                |       |      |                           |        |        |     |           |     |     |      |      |
| Partial factor $\gamma_{Ms,V}$                                                                                                                                                              | Steel zinc plated                                        | Property class | 4.8   | [-]  | 1.25                      |        |        |     |           |     |     |      |      |
|                                                                                                                                                                                             |                                                          |                | 5.8   |      | 1.25                      |        |        |     |           |     |     |      |      |
|                                                                                                                                                                                             |                                                          |                | 8.8   |      | 1.25                      |        |        |     |           |     |     |      |      |
|                                                                                                                                                                                             | Stainless steel R and high corrosion resistant steel HCR |                | 50    |      | 2.38                      |        |        |     |           |     |     |      |      |
|                                                                                                                                                                                             |                                                          |                | 70    |      | 1.25 <sup>2)</sup> / 1.56 |        |        |     |           |     |     |      |      |
|                                                                                                                                                                                             |                                                          |                | 80    |      | 1.33                      |        |        |     |           |     |     |      |      |
| <sup>1)</sup> In absence of other national regulations                                                                                                                                      |                                                          |                |       |      |                           |        |        |     |           |     |     |      |      |
| <sup>2)</sup> Only admissible for high corrosion resist. steel HCR, with $f_{yk} / f_{uk} \geq 0,8$ and $A_5 > 12 \%$ (e.g. fischer anchor rods)                                            |                                                          |                |       |      |                           |        |        |     |           |     |     |      |      |
| <sup>3)</sup> Values in brackets are valid for undersized threaded rods with smaller stress area $A_s$ for hot dip galvanised standard threaded rods according to EN ISO 10684:2004+AC:2009 |                                                          |                |       |      |                           |        |        |     |           |     |     |      |      |
| fischer injection system FIS V                                                                                                                                                              |                                                          |                |       |      |                           |        |        |     | Annex C 1 |     |     |      |      |
| Performances<br>Characteristic values for steel failure under tension / shear load of fischer anchor rods and standard threaded rods                                                        |                                                          |                |       |      |                           |        |        |     |           |     |     |      |      |

**Table C2.1: Characteristic values for steel failure under tension / shear load of fischer internal threaded anchors RG MI**

| fischer internal threaded anchors RG MI                                                                                      |                                |                   |                | M8   | M10  | M12  | M16       | M20  |      |
|------------------------------------------------------------------------------------------------------------------------------|--------------------------------|-------------------|----------------|------|------|------|-----------|------|------|
| Bearing capacity under tension load, steel failure                                                                           |                                |                   |                |      |      |      |           |      |      |
| Charact.<br>resistance with<br>screw                                                                                         | N <sub>Rk,s</sub>              | Property class    | 5.8            | [kN] | 19   | 29   | 43        | 79   | 123  |
|                                                                                                                              |                                |                   | 8.8            |      | 29   | 47   | 68        | 108  | 179  |
|                                                                                                                              |                                | Property class 70 | R              |      | 26   | 41   | 59        | 110  | 172  |
|                                                                                                                              |                                |                   | HCR            |      | 26   | 41   | 59        | 110  | 172  |
| Partial factors <sup>1)</sup>                                                                                                |                                |                   |                |      |      |      |           |      |      |
| Partial factors                                                                                                              | γ <sub>Ms,N</sub>              | Property class    | 5.8            | [-]  | 1,50 |      |           |      |      |
|                                                                                                                              |                                |                   | 8.8            |      | 1,50 |      |           |      |      |
|                                                                                                                              |                                | Property class 70 | R              |      | 1,87 |      |           |      |      |
|                                                                                                                              |                                |                   | HCR            |      | 1,87 |      |           |      |      |
| Bearing capacity under shear load, steel failure                                                                             |                                |                   |                |      |      |      |           |      |      |
| Without lever arm                                                                                                            |                                |                   |                |      |      |      |           |      |      |
| Charact.<br>resistance with<br>screw                                                                                         | V <sup>0</sup> <sub>Rk,s</sub> | Property class    | 5.8            | [kN] | 9,2  | 14,5 | 21,1      | 39,2 | 62,0 |
|                                                                                                                              |                                |                   | 8.8            |      | 14,6 | 23,2 | 33,7      | 54,0 | 90,0 |
|                                                                                                                              |                                | Property class 70 | R              |      | 12,8 | 20,3 | 29,5      | 54,8 | 86,0 |
|                                                                                                                              |                                |                   | HCR            |      | 12,8 | 20,3 | 29,5      | 54,8 | 86,0 |
| Ductility factor                                                                                                             |                                |                   | k <sub>7</sub> | [-]  | 1,0  |      |           |      |      |
| With lever arm                                                                                                               |                                |                   |                |      |      |      |           |      |      |
| Charact.<br>resistance with<br>screw                                                                                         | M <sup>0</sup> <sub>Rk,s</sub> | Property class    | 5.8            | [Nm] | 20   | 39   | 68        | 173  | 337  |
|                                                                                                                              |                                |                   | 8.8            |      | 30   | 60   | 105       | 266  | 519  |
|                                                                                                                              |                                | Property class 70 | R              |      | 26   | 52   | 92        | 232  | 454  |
|                                                                                                                              |                                |                   | HCR            |      | 26   | 52   | 92        | 232  | 454  |
| Partial factors <sup>1)</sup>                                                                                                |                                |                   |                |      |      |      |           |      |      |
| Partial factors                                                                                                              | γ <sub>Ms,V</sub>              | Property class    | 5.8            | [-]  | 1,25 |      |           |      |      |
|                                                                                                                              |                                |                   | 8.8            |      | 1,25 |      |           |      |      |
|                                                                                                                              |                                | Property class 70 | R              |      | 1,56 |      |           |      |      |
|                                                                                                                              |                                |                   | HCR            |      | 1,56 |      |           |      |      |
| <sup>1)</sup> In absence of other national regulations                                                                       |                                |                   |                |      |      |      |           |      |      |
| fischer injection system FIS V                                                                                               |                                |                   |                |      |      |      | Annex C 2 |      |      |
| Performances<br>Characteristic values for steel failure under tension / shear load of fischer internal threaded anchor RG MI |                                |                   |                |      |      |      |           |      |      |

**Table C3.1: Characteristic values for steel failure under tension / shear load of reinforcing bars**

| Nominal diameter of the bar                        | $\phi$       | 8    | 10                                    | 12 | 14 | 16 | 20 | 25 | 28 |
|----------------------------------------------------|--------------|------|---------------------------------------|----|----|----|----|----|----|
| Bearing capacity under tension load, steel failure |              |      |                                       |    |    |    |    |    |    |
| Characteristic resistance                          | $N_{Rk,s}$   | [kN] | $A_s \cdot f_{uk}^{(1)}$              |    |    |    |    |    |    |
| Bearing capacity under shear load, steel failure   |              |      |                                       |    |    |    |    |    |    |
| Without lever arm                                  |              |      |                                       |    |    |    |    |    |    |
| Characteristic resistance                          | $V^0_{Rk,s}$ | [kN] | $0,5 \cdot A_s \cdot f_{uk}^{(1)}$    |    |    |    |    |    |    |
| Ductility factor                                   | $k_7$        | [-]  | 1,0                                   |    |    |    |    |    |    |
| With lever arm                                     |              |      |                                       |    |    |    |    |    |    |
| Characteristic resistance                          | $M^0_{Rk,s}$ | [Nm] | $1,2 \cdot W_{el} \cdot f_{uk}^{(1)}$ |    |    |    |    |    |    |

<sup>1)</sup>  $f_{uk}$  or  $f_{yk}$  respectively must be taken from the specifications of the reinforcing bar

**Table C3.2: Characteristic values for steel failure under tension / shear load of fischer rebar anchors FRA**

| fischer rebar anchor FRA                           |                                |      | M12  | M16 | M20 | M24 |
|----------------------------------------------------|--------------------------------|------|------|-----|-----|-----|
| Bearing capacity under tension load, steel failure |                                |      |      |     |     |     |
| Characteristic resistance                          | N <sub>Rk,s</sub>              | [kN] | 63   | 111 | 173 | 270 |
| Partial factor <sup>1)</sup>                       |                                |      |      |     |     |     |
| Partial factor                                     | γ <sub>Ms,N</sub>              | [-]  | 1,4  |     |     |     |
| Bearing capacity under shear load, steel failure   |                                |      |      |     |     |     |
| Without lever arm                                  |                                |      |      |     |     |     |
| Characteristic resistance                          | V <sup>0</sup> <sub>Rk,s</sub> | [kN] | 30   | 55  | 86  | 124 |
| Ductility factor                                   | k <sub>7</sub>                 | [-]  | 1,0  |     |     |     |
| With lever arm                                     |                                |      |      |     |     |     |
| Characteristic resistance                          | M <sup>0</sup> <sub>Rk,s</sub> | [Nm] | 92   | 233 | 454 | 785 |
| Partial factor <sup>1)</sup>                       |                                |      |      |     |     |     |
| Partial factor                                     | γ <sub>Ms,V</sub>              | [-]  | 1,56 |     |     |     |

<sup>1)</sup> In absence of other national regulations

fischer injection system FIS V

**Performances**

Characteristic values for steel failure under tension / shear load of reinforcing bars and fischer rebar anchors FRA

**Annex C 3**

| Table C4.1: Characteristic values for concrete failure under tension / shear load     |                          |                 |           |                                                                                                                            |                 |                 |     |                |           |                 |                 |                 |
|---------------------------------------------------------------------------------------|--------------------------|-----------------|-----------|----------------------------------------------------------------------------------------------------------------------------|-----------------|-----------------|-----|----------------|-----------|-----------------|-----------------|-----------------|
| Size                                                                                  |                          |                 | All sizes |                                                                                                                            |                 |                 |     |                |           |                 |                 |                 |
| Tension load                                                                          |                          |                 |           |                                                                                                                            |                 |                 |     |                |           |                 |                 |                 |
| Installation factor                                                                   |                          | $\gamma_{inst}$ | [-]       | See annex C 5 to C 8 and C 13 to C14                                                                                       |                 |                 |     |                |           |                 |                 |                 |
| Factors for the compressive strength of concrete > C20/25                             |                          |                 |           |                                                                                                                            |                 |                 |     |                |           |                 |                 |                 |
| Increasing factor for $\tau_{Rk}$                                                     | C25/30                   | $\Psi_c$        | [-]       | 1,05                                                                                                                       |                 |                 |     |                |           |                 |                 |                 |
|                                                                                       | C30/37                   |                 |           | 1,10                                                                                                                       |                 |                 |     |                |           |                 |                 |                 |
|                                                                                       | C35/45                   |                 |           | 1,15                                                                                                                       |                 |                 |     |                |           |                 |                 |                 |
|                                                                                       | C40/50                   |                 |           | 1,19                                                                                                                       |                 |                 |     |                |           |                 |                 |                 |
|                                                                                       | C45/55                   |                 |           | 1,22                                                                                                                       |                 |                 |     |                |           |                 |                 |                 |
|                                                                                       | C50/60                   |                 |           | 1,26                                                                                                                       |                 |                 |     |                |           |                 |                 |                 |
| Splitting failure                                                                     |                          |                 |           |                                                                                                                            |                 |                 |     |                |           |                 |                 |                 |
| Edge distance                                                                         | $h / h_{ef} \geq 2,0$    | $C_{cr,sp}$     | [mm]      | 1,0 $h_{ef}$                                                                                                               |                 |                 |     |                |           |                 |                 |                 |
|                                                                                       | $2,0 > h / h_{ef} > 1,3$ |                 |           | 4,6 $h_{ef}$ - 1,8 h                                                                                                       |                 |                 |     |                |           |                 |                 |                 |
|                                                                                       | $h / h_{ef} \leq 1,3$    |                 |           | 2,26 $h_{ef}$                                                                                                              |                 |                 |     |                |           |                 |                 |                 |
| Spacing                                                                               |                          | $S_{cr,sp}$     |           | 2 $C_{cr,sp}$                                                                                                              |                 |                 |     |                |           |                 |                 |                 |
| Concrete cone failure                                                                 |                          |                 |           |                                                                                                                            |                 |                 |     |                |           |                 |                 |                 |
| Uncracked concrete                                                                    |                          | $k_{ucr,N}$     | [-]       | 11,0                                                                                                                       |                 |                 |     |                |           |                 |                 |                 |
| Cracked concrete                                                                      |                          | $k_{cr,N}$      |           | 7,7                                                                                                                        |                 |                 |     |                |           |                 |                 |                 |
| Edge distance                                                                         |                          | $C_{cr,N}$      | [mm]      | 1,5 $h_{ef}$                                                                                                               |                 |                 |     |                |           |                 |                 |                 |
| Spacing                                                                               |                          | $S_{cr,N}$      |           | 2 $C_{cr,N}$                                                                                                               |                 |                 |     |                |           |                 |                 |                 |
| Factors for sustained tension load                                                    |                          |                 |           |                                                                                                                            |                 |                 |     |                |           |                 |                 |                 |
| Temperature range                                                                     |                          |                 | [-]       | 50 °C / 80 °C                                                                                                              |                 |                 |     | 72 °C / 120 °C |           |                 |                 |                 |
| Factor                                                                                |                          | $\Psi_{sus}^0$  | [-]       | 0,74                                                                                                                       |                 |                 |     | 0,87           |           |                 |                 |                 |
| Shear load                                                                            |                          |                 |           |                                                                                                                            |                 |                 |     |                |           |                 |                 |                 |
| Installation factor                                                                   |                          | $\gamma_{inst}$ | [-]       | 1,0                                                                                                                        |                 |                 |     |                |           |                 |                 |                 |
| Concrete pry-out failure                                                              |                          |                 |           |                                                                                                                            |                 |                 |     |                |           |                 |                 |                 |
| Factor for pry-out failure                                                            |                          | $k_8$           | [-]       | 2,0                                                                                                                        |                 |                 |     |                |           |                 |                 |                 |
| Concrete edge failure                                                                 |                          |                 |           |                                                                                                                            |                 |                 |     |                |           |                 |                 |                 |
| Effective length of fastener in shear loading                                         |                          | $l_f$           | [mm]      | for $d_{nom} \leq 24$ mm: min ( $h_{ef}$ ; 12 $d_{nom}$ )<br>for $d_{nom} > 24$ mm: min ( $h_{ef}$ ; 8 $d_{nom}$ ; 300 mm) |                 |                 |     |                |           |                 |                 |                 |
| Calculation diameters                                                                 |                          |                 |           |                                                                                                                            |                 |                 |     |                |           |                 |                 |                 |
| Size                                                                                  |                          |                 |           | M6                                                                                                                         | M8              | M10             | M12 | M16            | M20       | M24             | M27             | M30             |
| fischer anchor rods and standard threaded rods                                        |                          | $d_{nom}$       | [mm]      | 6                                                                                                                          | 8               | 10              | 12  | 16             | 20        | 24              | 27              | 30              |
| fischer internal threaded anchors RG MI                                               |                          | $d_{nom}$       |           | - <sup>1)</sup>                                                                                                            | 12              | 16              | 18  | 22             | 28        | - <sup>1)</sup> | - <sup>1)</sup> | - <sup>1)</sup> |
| fischer rebar anchor FRA                                                              |                          | $d_{nom}$       |           | - <sup>1)</sup>                                                                                                            | - <sup>1)</sup> | - <sup>1)</sup> | 12  | 16             | 20        | 25              | - <sup>1)</sup> | - <sup>1)</sup> |
| Size (nominal diameter of the bar)                                                    |                          | $\phi$          |           | 8                                                                                                                          | 10              | 12              | 14  | 16             | 20        | 25              | 28              |                 |
| Reinforcing bar                                                                       |                          | $d_{nom}$       | [mm]      | 8                                                                                                                          | 10              | 12              | 14  | 16             | 20        | 25              | 28              |                 |
| <sup>1)</sup> Anchor type not part of the assessment                                  |                          |                 |           |                                                                                                                            |                 |                 |     |                |           |                 |                 |                 |
| fischer injection system FIS V                                                        |                          |                 |           |                                                                                                                            |                 |                 |     |                | Annex C 4 |                 |                 |                 |
| Performances<br>Characteristic values for concrete failure under tension / shear load |                          |                 |           |                                                                                                                            |                 |                 |     |                |           |                 |                 |                 |

**Table C5.1: Characteristic values for combined pull-out and concrete failure for fischer anchor rods and standard threaded rods in hammer drilled holes; uncracked or cracked concrete**

| Anchor rod / standard threaded rod                                                                                                                    |                    |                 | M6                   | M8              | M10             | M12             | M16               | M20  | M24       | M27 | M30 |     |
|-------------------------------------------------------------------------------------------------------------------------------------------------------|--------------------|-----------------|----------------------|-----------------|-----------------|-----------------|-------------------|------|-----------|-----|-----|-----|
| Combined pullout and concrete cone failure                                                                                                            |                    |                 |                      |                 |                 |                 |                   |      |           |     |     |     |
| Calculation diameter                                                                                                                                  |                    | d               | [mm]                 | 6               | 8               | 10              | 12                | 16   | 20        | 24  | 27  | 30  |
| Uncracked concrete                                                                                                                                    |                    |                 |                      |                 |                 |                 |                   |      |           |     |     |     |
| Characteristic bond resistance in uncracked concrete C20/25                                                                                           |                    |                 |                      |                 |                 |                 |                   |      |           |     |     |     |
| Hammer-drilling with standard drill bit or hollow drill bit (dry or wet concrete)                                                                     |                    |                 |                      |                 |                 |                 |                   |      |           |     |     |     |
| Temperature range                                                                                                                                     | I: 50 °C / 80 °C   | $\tau_{Rk,ucr}$ | [N/mm <sup>2</sup> ] | 9,0             | 11,0            | 11,0            | 11,0              | 10,0 | 9,5       | 9,0 | 8,5 | 8,5 |
|                                                                                                                                                       | II: 72 °C / 120 °C |                 |                      | 6,5             | 9,5             | 9,5             | 9,0               | 8,5  | 8,0       | 7,5 | 7,0 | 7,0 |
| Hammer-drilling with standard drill bit or hollow drill bit (water filled hole) <sup>1)</sup>                                                         |                    |                 |                      |                 |                 |                 |                   |      |           |     |     |     |
| Temperature range                                                                                                                                     | I: 50 °C / 80 °C   | $\tau_{Rk,ucr}$ | [N/mm <sup>2</sup> ] | - <sup>2)</sup> | - <sup>2)</sup> | - <sup>2)</sup> | 9,5               | 8,5  | 8,0       | 7,5 | 7,0 | 7,0 |
|                                                                                                                                                       | II: 72 °C / 120 °C |                 |                      | - <sup>2)</sup> | - <sup>2)</sup> | - <sup>2)</sup> | 7,5               | 7,0  | 6,5       | 6,0 | 6,0 | 6,0 |
| Installation factors                                                                                                                                  |                    |                 |                      |                 |                 |                 |                   |      |           |     |     |     |
| Dry or wet concrete                                                                                                                                   |                    | $\gamma_{inst}$ | [-]                  | 1,0             |                 |                 |                   |      |           |     |     |     |
| Water filled hole                                                                                                                                     |                    |                 |                      | - <sup>2)</sup> | - <sup>2)</sup> | - <sup>2)</sup> | 1,2 <sup>1)</sup> |      |           |     |     |     |
| Cracked concrete                                                                                                                                      |                    |                 |                      |                 |                 |                 |                   |      |           |     |     |     |
| Characteristic bond resistance in cracked concrete C20/25                                                                                             |                    |                 |                      |                 |                 |                 |                   |      |           |     |     |     |
| Hammer-drilling with standard drill bit or hollow drill bit (dry or wet concrete)                                                                     |                    |                 |                      |                 |                 |                 |                   |      |           |     |     |     |
| Temperature range                                                                                                                                     | I: 50 °C / 80 °C   | $\tau_{Rk,cr}$  | [N/mm <sup>2</sup> ] | - <sup>2)</sup> | 5,5             | 6,0             | 6,0               | 6,0  | 5,5       | 4,5 | 4,0 | 4,0 |
|                                                                                                                                                       | II: 72 °C / 120 °C |                 |                      | - <sup>2)</sup> | 4,5             | 5,0             | 6,0               | 6,0  | 5,0       | 4,0 | 3,5 | 3,5 |
| Hammer-drilling with standard drill bit or hollow drill bit (water filled hole) <sup>1)</sup>                                                         |                    |                 |                      |                 |                 |                 |                   |      |           |     |     |     |
| Temperature range                                                                                                                                     | I: 50 °C / 80 °C   | $\tau_{Rk,cr}$  | [N/mm <sup>2</sup> ] | - <sup>2)</sup> | - <sup>2)</sup> | - <sup>2)</sup> | 5,0               | 5,0  | 4,5       | 4,0 | 3,5 | 3,5 |
|                                                                                                                                                       | II: 72 °C / 120 °C |                 |                      | - <sup>2)</sup> | - <sup>2)</sup> | - <sup>2)</sup> | 4,0               | 4,0  | 4,0       | 3,5 | 3,0 | 3,0 |
| Installation factors                                                                                                                                  |                    |                 |                      |                 |                 |                 |                   |      |           |     |     |     |
| Dry or wet concrete                                                                                                                                   |                    | $\gamma_{inst}$ | [-]                  | 1,0             |                 |                 |                   |      |           |     |     |     |
| Water filled hole                                                                                                                                     |                    |                 |                      | - <sup>2)</sup> | - <sup>2)</sup> | - <sup>2)</sup> | 1,2 <sup>1)</sup> |      |           |     |     |     |
| <div><div><sup>1)</sup> Only with coaxial cartridges: 380ml, 400 ml, 410 ml</div><div><sup>2)</sup> No performance assessed</div></div>               |                    |                 |                      |                 |                 |                 |                   |      |           |     |     |     |
| fischer injection system FIS V                                                                                                                        |                    |                 |                      |                 |                 |                 |                   |      | Annex C 5 |     |     |     |
| <div>Performances</div> <div>Characteristic values for combined pull-out and concrete failure for fischer anchor rod and standard threaded rods</div> |                    |                 |                      |                 |                 |                 |                   |      |           |     |     |     |

**Table C6.1: Characteristic values for combined pull-out and concrete failure for fischer internal threaded anchors RG MI in hammer drilled holes; uncracked concrete**

| Internal threaded anchor RG MI                                                                |                    |                 | M8                   | M10               | M12  | M16 | M20 |     |
|-----------------------------------------------------------------------------------------------|--------------------|-----------------|----------------------|-------------------|------|-----|-----|-----|
| Combined pullout and concrete cone failure                                                    |                    |                 |                      |                   |      |     |     |     |
| Calculation diameter                                                                          |                    | d               | [mm]                 | 12                | 16   | 18  | 22  | 28  |
| Uncracked concrete                                                                            |                    |                 |                      |                   |      |     |     |     |
| Characteristic bond resistance in uncracked concrete C20/25                                   |                    |                 |                      |                   |      |     |     |     |
| Hammer-drilling with standard drill bit or hollow drill bit (dry or wet concrete)             |                    |                 |                      |                   |      |     |     |     |
| Tem-<br>perature<br>range                                                                     | I: 50 °C / 80 °C   | $\tau_{Rk,ucr}$ | [N/mm <sup>2</sup> ] | 10,5              | 10,0 | 9,5 | 9,0 | 8,5 |
|                                                                                               | II: 72 °C / 120 °C |                 |                      | 9,0               | 8,0  | 8,0 | 7,5 | 7,0 |
| Hammer-drilling with standard drill bit or hollow drill bit (water filled hole) <sup>1)</sup> |                    |                 |                      |                   |      |     |     |     |
| Tem-<br>perature<br>range                                                                     | I: 50 °C / 80 °C   | $\tau_{Rk,ucr}$ | [N/mm <sup>2</sup> ] | 10,0              | 9,0  | 9,0 | 8,5 | 8,0 |
|                                                                                               | II: 72 °C / 120 °C |                 |                      | 7,5               | 6,5  | 6,5 | 6,0 | 6,0 |
| Installation factors                                                                          |                    |                 |                      |                   |      |     |     |     |
| Dry or wet concrete                                                                           |                    | $\gamma_{inst}$ | [-]                  | 1,0               |      |     |     |     |
| Water filled hole                                                                             |                    |                 |                      | 1,2 <sup>1)</sup> |      |     |     |     |

<sup>1)</sup> Only with coaxial cartridges: 380 ml, 400 ml, 410 ml

fischer injection system FIS V

**Performances**

Characteristic values for combined pull-out and concrete failure for fischer internal threaded anchors RG MI

**Annex C 6**

| Table C7.1: Characteristic values for combined pull-out and concrete failure for reinforcing bars in hammer drilled holes; uncracked or cracked concrete |                    |                 |                      |                 |      |      |      |      |           |     |     |
|----------------------------------------------------------------------------------------------------------------------------------------------------------|--------------------|-----------------|----------------------|-----------------|------|------|------|------|-----------|-----|-----|
| Nominal diameter of the bar                                                                                                                              |                    | $\phi$          | 8                    | 10              | 12   | 14   | 16   | 20   | 25        | 28  |     |
| Combined pullout and concrete cone failure                                                                                                               |                    |                 |                      |                 |      |      |      |      |           |     |     |
| Calculation diameter                                                                                                                                     |                    | d               | [mm]                 | 8               | 10   | 12   | 14   | 16   | 20        | 25  | 28  |
| Uncracked concrete                                                                                                                                       |                    |                 |                      |                 |      |      |      |      |           |     |     |
| Characteristic bond resistance in uncracked concrete C20/25                                                                                              |                    |                 |                      |                 |      |      |      |      |           |     |     |
| Hammer-drilling with standard drill bit or hollow drill bit (dry or wet concrete)                                                                        |                    |                 |                      |                 |      |      |      |      |           |     |     |
| Temperature range                                                                                                                                        | I: 50 °C / 80 °C   | $\tau_{Rk,ucr}$ | [N/mm <sup>2</sup> ] | 11,0            | 11,0 | 11,0 | 10,0 | 10,0 | 9,5       | 9,0 | 8,5 |
|                                                                                                                                                          | II: 72 °C / 120 °C |                 |                      | 9,5             | 9,5  | 9,0  | 8,5  | 8,5  | 8,0       | 7,5 | 7,0 |
| Installation factor                                                                                                                                      |                    |                 |                      |                 |      |      |      |      |           |     |     |
| Dry or wet concrete                                                                                                                                      |                    | $\gamma_{inst}$ | [-]                  | 1,0             |      |      |      |      |           |     |     |
| Cracked concrete                                                                                                                                         |                    |                 |                      |                 |      |      |      |      |           |     |     |
| Characteristic bond resistance in cracked concrete C20/25                                                                                                |                    |                 |                      |                 |      |      |      |      |           |     |     |
| Hammer-drilling with standard drill bit or hollow drill bit (dry or wet concrete)                                                                        |                    |                 |                      |                 |      |      |      |      |           |     |     |
| Temperature range                                                                                                                                        | I: 50 °C / 80 °C   | $\tau_{Rk,cr}$  | [N/mm <sup>2</sup> ] | - <sup>1)</sup> | 3,0  | 5,0  | 5,0  | 5,0  | 4,5       | 4,0 | 4,0 |
|                                                                                                                                                          | II: 72 °C / 120 °C |                 |                      | - <sup>1)</sup> | 3,0  | 4,5  | 4,5  | 4,5  | 4,0       | 3,5 | 3,5 |
| Installation factor                                                                                                                                      |                    |                 |                      |                 |      |      |      |      |           |     |     |
| Dry or wet concrete                                                                                                                                      |                    | $\gamma_{inst}$ | [-]                  | 1,0             |      |      |      |      |           |     |     |
| <div><div><sup>1)</sup> No performance assessed</div></div>                                                                                              |                    |                 |                      |                 |      |      |      |      |           |     |     |
| fischer injection system FIS V                                                                                                                           |                    |                 |                      |                 |      |      |      |      | Annex C 7 |     |     |
| Performances<br>Characteristic values for combined pull-out and concrete failure for reinforcing bars                                                    |                    |                 |                      |                 |      |      |      |      |           |     |     |

**Table C8.1: Characteristic values for combined pull-out and concrete failure for fischer rebar anchors FRA in hammer drilled holes; uncracked or cracked concrete**

| fischer rebar anchor FRA                                                                                       |                    | M12             | M16     | M20       | M24  |     |     |
|----------------------------------------------------------------------------------------------------------------|--------------------|-----------------|---------|-----------|------|-----|-----|
| Combined pullout and concrete cone failure                                                                     |                    |                 |         |           |      |     |     |
| Calculation diameter                                                                                           |                    | d               | [mm]    | 12        | 16   | 20  | 25  |
| Uncracked concrete                                                                                             |                    |                 |         |           |      |     |     |
| Characteristic bond resistance in uncracked concrete C20/25                                                    |                    |                 |         |           |      |     |     |
| Hammer-drilling with standard drill bit or hollow drill bit (dry or wet concrete)                              |                    |                 |         |           |      |     |     |
| Tem-<br>perature<br>range                                                                                      | I: 50 °C / 80 °C   | $\tau_{Rk,ucr}$ | [N/mm²] | 11,0      | 10,0 | 9,5 | 9,5 |
|                                                                                                                | II: 72 °C / 120 °C |                 |         | 9,0       | 8,5  | 8,0 | 7,5 |
| Installation factors                                                                                           |                    |                 |         |           |      |     |     |
| Dry or wet concrete                                                                                            |                    | $\gamma_{inst}$ | [-]     | 1,0       |      |     |     |
| Cracked concrete                                                                                               |                    |                 |         |           |      |     |     |
| Characteristic bond resistance in cracked concrete C20/25                                                      |                    |                 |         |           |      |     |     |
| Hammer-drilling with standard drill bit or hollow drill bit (dry or wet concrete)                              |                    |                 |         |           |      |     |     |
| Tem-<br>perature<br>range                                                                                      | I: 50 °C / 80 °C   | $\tau_{Rk,cr}$  | [N/mm²] | 5,0       | 5,0  | 4,5 | 4,0 |
|                                                                                                                | II: 72 °C / 120 °C |                 |         | 4,5       | 4,5  | 4,0 | 3,5 |
| Installation factors                                                                                           |                    |                 |         |           |      |     |     |
| Dry or wet concrete                                                                                            |                    | $\gamma_{inst}$ | [-]     | 1,0       |      |     |     |
|                                                                                                                |                    |                 |         |           |      |     |     |
|                                                                                                                |                    |                 |         |           |      |     |     |
| fischer injection system FIS V                                                                                 |                    |                 |         | Annex C 8 |      |     |     |
| Performances<br>Characteristic values for combined pull-out and concrete failure for fischer rebar anchors FRA |                    |                 |         |           |      |     |     |

**Table C9.1: Displacements for anchor rods**

| Anchor rod                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                        |                           | M6              | M8   | M10  | M12  | M16  | M20  | M24  | M27  | M30  |
|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|---------------------------|-----------------|------|------|------|------|------|------|------|------|
| Displacement-Factors for tension load <sup>1)</sup>                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                               |                           |                 |      |      |      |      |      |      |      |      |
| Uncracked concrete; Temperature range I, II                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                       |                           |                 |      |      |      |      |      |      |      |      |
| δ <sub>N0</sub> -Factor                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                           | [mm/(N/mm <sup>2</sup> )] | 0,09            | 0,09 | 0,09 | 0,10 | 0,10 | 0,10 | 0,10 | 0,11 | 0,12 |
| δ <sub>N∞</sub> -Factor                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                           |                           | 0,10            | 0,10 | 0,10 | 0,12 | 0,12 | 0,12 | 0,13 | 0,13 | 0,14 |
| Cracked concrete; Temperature range I, II                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                         |                           |                 |      |      |      |      |      |      |      |      |
| δ <sub>N0</sub> -Factor                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                           | [mm/(N/mm <sup>2</sup> )] | - <sup>3)</sup> | 0,12 | 0,12 | 0,12 | 0,13 | 0,13 | 0,13 | 0,14 | 0,15 |
| δ <sub>N0</sub> -Factor                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                           |                           | - <sup>3)</sup> | 0,25 | 0,27 | 0,30 | 0,30 | 0,30 | 0,35 | 0,35 | 0,40 |
| Displacement-Factors for shear load <sup>2)</sup>                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                 |                           |                 |      |      |      |      |      |      |      |      |
| Uncracked or cracked concrete; Temperature range I, II                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                            |                           |                 |      |      |      |      |      |      |      |      |
| δ <sub>V0</sub> -Factor                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                           | [mm/kN]                   | 0,11            | 0,11 | 0,11 | 0,10 | 0,10 | 0,09 | 0,09 | 0,08 | 0,07 |
| δ <sub>V∞</sub> -Factor                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                           |                           | 0,12            | 0,12 | 0,12 | 0,11 | 0,11 | 0,10 | 0,10 | 0,09 | 0,09 |
| <div><div><div>1) Calculation of effective displacement:</div><div>δ<sub>N0</sub> = δ<sub>N0</sub>-Factor · τ<sub>Ed</sub></div><div>δ<sub>N∞</sub> = δ<sub>N∞</sub>-Factor · τ<sub>Ed</sub></div><div>(τ<sub>Ed</sub>: Design value of the applied tensile stress)</div></div><div><div>2) Calculation of effective displacement:</div><div>δ<sub>V0</sub> = δ<sub>V0</sub>-Factor · V<sub>Ed</sub></div><div>δ<sub>V∞</sub> = δ<sub>V∞</sub>-Factor · V<sub>Ed</sub></div><div>(V<sub>Ed</sub>: Design value of the applied shear force)</div></div><div>3) No performance assessed</div></div> |                           |                 |      |      |      |      |      |      |      |      |

**Table C9.2: Displacements for fischer internal threaded anchors RG MI**

| Internal threaded anchor RG MI                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                       |                           | M8   | M10  | M12  | M16       | M20  |
|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|---------------------------|------|------|------|-----------|------|
| Displacement-Factors for tension load <sup>1)</sup>                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                  |                           |      |      |      |           |      |
| Uncracked concrete; Temperature range I, II                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                          |                           |      |      |      |           |      |
| δ <sub>N0</sub> -Factor                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                              | [mm/(N/mm <sup>2</sup> )] | 0,10 | 0,11 | 0,12 | 0,13      | 0,14 |
| δ <sub>N∞</sub> -Factor                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                              |                           | 0,13 | 0,14 | 0,15 | 0,16      | 0,18 |
| Displacement-Factors for shear load <sup>2)</sup>                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                    |                           |      |      |      |           |      |
| Uncracked concrete; Temperature range I, II                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                          |                           |      |      |      |           |      |
| δ <sub>V0</sub> -Factor                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                              | [mm/kN]                   | 0,12 | 0,12 | 0,12 | 0,12      | 0,12 |
| δ <sub>V∞</sub> -Factor                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                              |                           | 0,14 | 0,14 | 0,14 | 0,14      | 0,14 |
| <div><div>1) Calculation of effective displacement:<br/><math>\delta_{N0} = \delta_{N0\text{-Factor}} \cdot \tau_{Ed}</math><br/><math>\delta_{N\infty} = \delta_{N\infty\text{-Factor}} \cdot \tau_{Ed}</math><br/>(τ<sub>Ed</sub>: Design value of the applied tensile stress)</div><div>2) Calculation of effective displacement:<br/><math>\delta_{V0} = \delta_{V0\text{-Factor}} \cdot V_{Ed}</math><br/><math>\delta_{V\infty} = \delta_{V\infty\text{-Factor}} \cdot V_{Ed}</math><br/>(V<sub>Ed</sub>: Design value of the applied shear force)</div></div> |                           |      |      |      |           |      |
| fischer injection system FIS V                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                       |                           |      |      |      | Annex C 9 |      |
| Performances<br>Displacements for anchor rods and fischer internal threaded anchors RG MI                                                                                                                                                                                                                                                                                                                                                                                                                                                                            |                           |      |      |      |           |      |

**Table C10.1: Displacements for reinforcing bars**

| Nominal diameter of the bar $\phi$                                                                                                                                                                                                           |                           | 8               | 10   | 12   | 14                                                                                                                                                                                                                               | 16   | 20   | 25   | 28   |
|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|---------------------------|-----------------|------|------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------|------|------|------|
| Displacement-Factors for tension load <sup>1)</sup>                                                                                                                                                                                          |                           |                 |      |      |                                                                                                                                                                                                                                  |      |      |      |      |
| Uncracked concrete; Temperature range I, II                                                                                                                                                                                                  |                           |                 |      |      |                                                                                                                                                                                                                                  |      |      |      |      |
| $\delta_{N0}$ -Factor                                                                                                                                                                                                                        | [mm/(N/mm <sup>2</sup> )] | 0,09            | 0,09 | 0,10 | 0,10                                                                                                                                                                                                                             | 0,10 | 0,10 | 0,10 | 0,11 |
| $\delta_{N\infty}$ -Factor                                                                                                                                                                                                                   |                           | 0,10            | 0,10 | 0,12 | 0,12                                                                                                                                                                                                                             | 0,12 | 0,12 | 0,13 | 0,13 |
| Cracked concrete; Temperature range I, II                                                                                                                                                                                                    |                           |                 |      |      |                                                                                                                                                                                                                                  |      |      |      |      |
| $\delta_{N0}$ -Factor                                                                                                                                                                                                                        | [mm/(N/mm <sup>2</sup> )] | - <sup>3)</sup> | 0,12 | 0,13 | 0,13                                                                                                                                                                                                                             | 0,13 | 0,13 | 0,13 | 0,14 |
| $\delta_{N\infty}$ -Factor                                                                                                                                                                                                                   |                           | - <sup>3)</sup> | 0,27 | 0,30 | 0,30                                                                                                                                                                                                                             | 0,30 | 0,30 | 0,35 | 0,37 |
| Displacement-Factors for shear load <sup>2)</sup>                                                                                                                                                                                            |                           |                 |      |      |                                                                                                                                                                                                                                  |      |      |      |      |
| Uncracked or cracked concrete; Temperature range I, II                                                                                                                                                                                       |                           |                 |      |      |                                                                                                                                                                                                                                  |      |      |      |      |
| $\delta_{V0}$ -Factor                                                                                                                                                                                                                        | [mm/kN]                   | 0,11            | 0,11 | 0,10 | 0,10                                                                                                                                                                                                                             | 0,10 | 0,09 | 0,09 | 0,08 |
| $\delta_{V\infty}$ -Factor                                                                                                                                                                                                                   |                           | 0,12            | 0,12 | 0,11 | 0,11                                                                                                                                                                                                                             | 0,11 | 0,10 | 0,10 | 0,09 |
| 1) Calculation of effective displacement:<br>$\delta_{N0} = \delta_{N0}\text{-Factor} \cdot \tau_{Ed}$<br>$\delta_{N\infty} = \delta_{N\infty}\text{-Factor} \cdot \tau_{Ed}$<br>( $\tau_{Ed}$ : Design value of the applied tensile stress) |                           |                 |      |      | 2) Calculation of effective displacement:<br>$\delta_{V0} = \delta_{V0}\text{-Factor} \cdot V_{Ed}$<br>$\delta_{V\infty} = \delta_{V\infty}\text{-Factor} \cdot V_{Ed}$<br>( $V_{Ed}$ : Design value of the applied shear force) |      |      |      |      |
| 3) No performance assessed                                                                                                                                                                                                                   |                           |                 |      |      |                                                                                                                                                                                                                                  |      |      |      |      |

**Table C10.2: Displacements for fischer rebar anchors FRA**

| fischer rebar anchor FRA                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                    |                           | M12  | M16  | M20  | M24        |
|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|---------------------------|------|------|------|------------|
| Displacement-Factors for tension load <sup>1)</sup>                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                         |                           |      |      |      |            |
| Uncracked concrete; Temperature range I, II                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                 |                           |      |      |      |            |
| $\delta_{N0}$ -Factor                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                       | [mm/(N/mm <sup>2</sup> )] | 0,10 | 0,10 | 0,10 | 0,10       |
| $\delta_{N\infty}$ -Factor                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                  |                           | 0,12 | 0,12 | 0,12 | 0,13       |
| Cracked concrete; Temperature range I, II                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                   |                           |      |      |      |            |
| $\delta_{N0}$ -Factor                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                       | [mm/(N/mm <sup>2</sup> )] | 0,12 | 0,13 | 0,13 | 0,13       |
| $\delta_{N\infty}$ -Factor                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                  |                           | 0,30 | 0,30 | 0,30 | 0,35       |
| Displacement-Factors for shear load <sup>2)</sup>                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                           |                           |      |      |      |            |
| Uncracked or cracked concrete; Temperature range I, II                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                      |                           |      |      |      |            |
| $\delta_{V0}$ -Factor                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                       | [mm/kN]                   | 0,10 | 0,10 | 0,09 | 0,09       |
| $\delta_{V\infty}$ -Factor                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                  |                           | 0,11 | 0,11 | 0,10 | 0,10       |
| <div><div><div>1) Calculation of effective displacement:</div><div><math>\delta_{N0} = \delta_{N0}\text{-Factor} \cdot \tau_{Ed}</math></div><div><math>\delta_{N\infty} = \delta_{N\infty}\text{-Factor} \cdot \tau_{Ed}</math></div><div>(<math>\tau_{Ed}</math>: Design value of the applied tensile stress)</div></div><div><div>2) Calculation of effective displacement:</div><div><math>\delta_{V0} = \delta_{V0}\text{-Factor} \cdot V_{Ed}</math></div><div><math>\delta_{V\infty} = \delta_{V\infty}\text{-Factor} \cdot V_{Ed}</math></div><div>(<math>V_{Ed}</math>: Design value of the applied shear force)</div></div></div> |                           |      |      |      |            |
| fischer injection system FIS V                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                              |                           |      |      |      | Annex C 10 |
| <b>Performances</b><br>Displacements for reinforcing bars and fischer rebar anchors FRA                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                     |                           |      |      |      |            |

**Table C11.1: Characteristic values for steel failure under tension / shear load of fischer anchor rods and standard threaded rods under seismic action performance category C1 or C2**

| Anchor rod / standard threaded rod                                                    |                                                          |                |                         | M10  | M12             | M16 | M20 | M24 | M27             | M30             |                 |
|---------------------------------------------------------------------------------------|----------------------------------------------------------|----------------|-------------------------|------|-----------------|-----|-----|-----|-----------------|-----------------|-----------------|
| Bearing capacity under tension load, steel failure <sup>1)</sup>                      |                                                          |                |                         |      |                 |     |     |     |                 |                 |                 |
| fischer anchor rods and standard threaded rods, performance category C1 <sup>2)</sup> |                                                          |                |                         |      |                 |     |     |     |                 |                 |                 |
| Characteristic resistance<br>$N_{Rk,s,C1}$                                            | Steel zinc plated                                        | Property class | 5.8                     | [kN] | 29(27)          | 43  | 79  | 123 | 177             | 230             | 281             |
|                                                                                       |                                                          |                | 8.8                     |      | 47(43)          | 68  | 126 | 196 | 282             | 368             | 449             |
|                                                                                       | Stainless steel R and high corrosion resistant steel HCR |                | 50                      |      | 29              | 43  | 79  | 123 | 177             | 230             | 281             |
|                                                                                       |                                                          |                | 70                      |      | 41              | 59  | 110 | 172 | 247             | 322             | 393             |
|                                                                                       |                                                          |                | 80                      |      | 47              | 68  | 126 | 196 | 282             | 368             | 449             |
| fischer anchor rods and standard threaded rods, performance category C2 <sup>2)</sup> |                                                          |                |                         |      |                 |     |     |     |                 |                 |                 |
| Characteristic resistance<br>$N_{Rk,s,C2}$                                            | Steel zinc plated                                        | Property class | 5.8                     | [kN] | — <sup>4)</sup> | 39  | 72  | 108 | — <sup>4)</sup> | — <sup>4)</sup> | — <sup>4)</sup> |
|                                                                                       |                                                          |                | 8.8                     |      | — <sup>4)</sup> | 61  | 116 | 173 | — <sup>4)</sup> | — <sup>4)</sup> | — <sup>4)</sup> |
|                                                                                       | Stainless steel R and high corrosion resistant steel HCR |                | 50                      |      | — <sup>4)</sup> | 39  | 72  | 108 | — <sup>4)</sup> | — <sup>4)</sup> | — <sup>4)</sup> |
|                                                                                       |                                                          |                | 70                      |      | — <sup>4)</sup> | 53  | 101 | 152 | — <sup>4)</sup> | — <sup>4)</sup> | — <sup>4)</sup> |
|                                                                                       |                                                          |                | 80                      |      | — <sup>4)</sup> | 61  | 116 | 173 | — <sup>4)</sup> | — <sup>4)</sup> | — <sup>4)</sup> |
| Bearing capacity under shear load, steel failure without lever arm <sup>1)</sup>      |                                                          |                |                         |      |                 |     |     |     |                 |                 |                 |
| fischer anchor rods, performance category C1 <sup>2)</sup>                            |                                                          |                |                         |      |                 |     |     |     |                 |                 |                 |
| Characteristic resistance<br>$V_{Rk,s,C1}$                                            | Steel zinc plated                                        | Property class | 5.8                     | [kN] | 17(16)          | 25  | 47  | 74  | 106             | 138             | 168             |
|                                                                                       |                                                          |                | 8.8                     |      | 23(21)          | 34  | 63  | 98  | 141             | 184             | 225             |
|                                                                                       | Stainless steel R and high corrosion resistant steel HCR |                | 50                      |      | 15              | 21  | 39  | 61  | 89              | 115             | 141             |
|                                                                                       |                                                          |                | 70                      |      | 20              | 30  | 55  | 86  | 124             | 161             | 197             |
|                                                                                       |                                                          |                | 80                      |      | 23              | 34  | 63  | 98  | 141             | 184             | 225             |
| Standard threaded rods, performance category C1 <sup>2)</sup>                         |                                                          |                |                         |      |                 |     |     |     |                 |                 |                 |
| Characteristic resistance<br>$V_{Rk,s,C1}$                                            | Steel zinc plated                                        | Property class | 5.8                     | [kN] | 12(11)          | 17  | 33  | 52  | 74              | 97              | 118             |
|                                                                                       |                                                          |                | 8.8                     |      | 16(14)          | 24  | 44  | 69  | 99              | 129             | 158             |
|                                                                                       | Stainless steel R and high corrosion resistant steel HCR |                | 50                      |      | 11              | 15  | 27  | 43  | 62              | 81              | 99              |
|                                                                                       |                                                          |                | 70                      |      | 14              | 21  | 39  | 60  | 87              | 113             | 138             |
|                                                                                       |                                                          |                | 80                      |      | 16              | 24  | 44  | 69  | 99              | 129             | 158             |
| fischer anchor rods and standard threaded rods, performance category C2               |                                                          |                |                         |      |                 |     |     |     |                 |                 |                 |
| Characteristic resistance<br>$V_{Rk,s,C2}$                                            | Steel zinc plated                                        | Property class | 5.8                     | [kN] | — <sup>4)</sup> | 14  | 27  | 43  | — <sup>4)</sup> | — <sup>4)</sup> | — <sup>4)</sup> |
|                                                                                       |                                                          |                | 8.8                     |      | — <sup>4)</sup> | 22  | 44  | 69  | — <sup>4)</sup> | — <sup>4)</sup> | — <sup>4)</sup> |
|                                                                                       | Stainless steel R and high corrosion resistant steel HCR |                | 50                      |      | — <sup>4)</sup> | 14  | 27  | 43  | — <sup>4)</sup> | — <sup>4)</sup> | — <sup>4)</sup> |
|                                                                                       |                                                          |                | 70                      |      | — <sup>4)</sup> | 20  | 39  | 60  | — <sup>4)</sup> | — <sup>4)</sup> | — <sup>4)</sup> |
|                                                                                       |                                                          |                | 80                      |      | — <sup>4)</sup> | 22  | 44  | 69  | — <sup>4)</sup> | — <sup>4)</sup> | — <sup>4)</sup> |
| Factor for the annular gap                                                            | $\alpha_{gap}$                                           | [-]            | 0,5 (1,0) <sup>3)</sup> |      |                 |     |     |     |                 |                 |                 |

<sup>1)</sup> Partial factors for performance category C1 or C2 see table C12.1;

for fischer anchor rods FIS A / RGM the factor for steel ductility is 1,0

<sup>2)</sup> Values in brackets are valid for undersized threaded rods with smaller stress area  $A_s$  for hot dip galvanised standard threaded rods according to EN ISO 10684:2004+AC:2009.

<sup>3)</sup> Values in brackets are valid for filled annular gaps between the anchor rod and the through-hole in the attachment. It is necessary to use the fischer filling disc according to Annex A 1

<sup>4)</sup> No performance assessed

fischer injection system FIS V

#### Performances

Characteristic values for steel failure under tension / shear load for fischer anchor rods and standard threaded rods under seismic action (performance category C1 / C2)

**Annex C 11**

**Table C12.1: Partial factors for fischer anchor rods, standard threaded rods under seismic action performance category C1 or C2**

| Anchor rod / standard threaded rod        |                                                          |                |     | M10 | M12                       | M16 | M20 | M24 | M27 | M30 |
|-------------------------------------------|----------------------------------------------------------|----------------|-----|-----|---------------------------|-----|-----|-----|-----|-----|
| Tension load, steel failure <sup>1)</sup> |                                                          |                |     |     |                           |     |     |     |     |     |
| Partial factor<br>$\gamma_{Ms,N}$         | Steel zinc plated                                        | Property class | 5.8 | [-] | 1,50                      |     |     |     |     |     |
|                                           |                                                          |                | 8.8 |     | 1,50                      |     |     |     |     |     |
|                                           | Stainless steel R and high corrosion resistant steel HCR |                | 50  |     | 2,86                      |     |     |     |     |     |
|                                           |                                                          |                | 70  |     | 1,50 <sup>2)</sup> / 1,87 |     |     |     |     |     |
|                                           |                                                          |                | 80  |     | 1,60                      |     |     |     |     |     |
|                                           |                                                          |                |     |     |                           |     |     |     |     |     |
| Shear load, steel failure <sup>1)</sup>   |                                                          |                |     |     |                           |     |     |     |     |     |
| Partial factor<br>$\gamma_{Ms,V}$         | Steel zinc plated                                        | Property class | 5.8 | [-] | 1,25                      |     |     |     |     |     |
|                                           |                                                          |                | 8.8 |     | 1,25                      |     |     |     |     |     |
|                                           | Stainless steel R and high corrosion resistant steel HCR |                | 50  |     | 2,38                      |     |     |     |     |     |
|                                           |                                                          |                | 70  |     | 1,25 <sup>2)</sup> / 1,56 |     |     |     |     |     |
|                                           |                                                          |                | 80  |     | 1,33                      |     |     |     |     |     |
|                                           |                                                          |                |     |     |                           |     |     |     |     |     |

<sup>1)</sup> In absence of other national regulations

<sup>2)</sup> Only admissible for high corrosion resistant steel HCR, with  $f_{yk} / f_{uk} \geq 0,8$  and  $A_5 > 12 \%$  (e.g. fischer anchor rods)

fischer injection system FIS V

**Performances**

Partial factors under seismic action (performance category C1 and C2) for fischer anchor rods and standard threaded rods

**Annex C 12**

**Table C13.1: Characteristic values** for combined pull-out and concrete failure for **fischer anchor rods** and **standard threaded rods** in hammer drilled holes under seismic action performance category **C1**

| Anchor rod / standard threaded rod                                                             |                    |                 | M10                  | M12             | M16               | M20 | M24 | M27 | M30 |     |
|------------------------------------------------------------------------------------------------|--------------------|-----------------|----------------------|-----------------|-------------------|-----|-----|-----|-----|-----|
| Characteristic bond resistance, combined pullout and concrete cone failure                     |                    |                 |                      |                 |                   |     |     |     |     |     |
| Hammer-drilling with standard drill bit or hollow drill bit (dry or wet concrete)              |                    |                 |                      |                 |                   |     |     |     |     |     |
| Tem-<br>perature<br>range                                                                      | I: 50 °C / 80 °C   | $\tau_{Rk,C1}$  | [N/mm <sup>2</sup> ] | 4,5             | 5,5               | 5,5 | 5,5 | 4,5 | 4,0 | 4,0 |
|                                                                                                | II: 72 °C / 120 °C |                 |                      | 4,0             | 4,5               | 4,5 | 4,5 | 4,0 | 3,5 | 3,5 |
| Hammer-drilling with standard drill bit or hollow drill bit (water filled hole <sup>1)</sup> ) |                    |                 |                      |                 |                   |     |     |     |     |     |
| Tem-<br>perature<br>range                                                                      | I: 50 °C / 80 °C   | $\tau_{Rk,C1}$  | [N/mm <sup>2</sup> ] | - <sup>2)</sup> | 5,0               | 5,0 | 4,5 | 4,0 | 3,5 | 3,5 |
|                                                                                                | II: 72 °C / 120 °C |                 |                      | - <sup>2)</sup> | 4,0               | 4,0 | 4,0 | 3,5 | 3,0 | 3,0 |
| Installation factors                                                                           |                    |                 |                      |                 |                   |     |     |     |     |     |
| Dry or wet concrete                                                                            |                    | $\gamma_{inst}$ | [-]                  | 1,0             |                   |     |     |     |     |     |
| Water filled hole                                                                              |                    |                 |                      | - <sup>2)</sup> | 1,2 <sup>1)</sup> |     |     |     |     |     |

<sup>1)</sup> Only with coaxial cartridges: 380ml, 400 ml, 410 ml

<sup>2)</sup> No performance assessed

fischer injection system FIS V

**Performances**

Characteristic values for combined pull-out and concrete failure under seismic action (performance category C1) for fischer anchor rods and standard threaded rods

**Annex C 13**

**Table C14.1: Characteristic values** for combined pull-out and concrete failure for **fischer anchor rods** and **standard threaded rods** in hammer drilled holes under seismic action performance category **C2**

| Anchor rod / standard threaded rod                                                             |                    |                           | M12                  | M16  | M20               |     |
|------------------------------------------------------------------------------------------------|--------------------|---------------------------|----------------------|------|-------------------|-----|
| Characteristic bond resistance, combined pullout and concrete cone failure                     |                    |                           |                      |      |                   |     |
| Hammer-drilling with standard drill bit or hollow drill bit (dry or wet concrete)              |                    |                           |                      |      |                   |     |
| Tem-<br>perature<br>range                                                                      | I: 50 °C / 80 °C   | $\tau_{Rk,C2}$            | [N/mm <sup>2</sup> ] | 1,5  | 1,3               | 2,1 |
|                                                                                                | II: 72 °C / 120 °C |                           |                      | 1,3  | 1,2               | 1,9 |
| Hammer-drilling with standard drill bit or hollow drill bit (water filled hole <sup>3)</sup> ) |                    |                           |                      |      |                   |     |
| Tem-<br>perature<br>range                                                                      | I: 50 °C / 80 °C   | $\tau_{Rk,C2}$            | [N/mm <sup>2</sup> ] | 1,3  | 1,1               | 1,8 |
|                                                                                                | II: 72 °C / 120 °C |                           |                      | 1,1  | 1,0               | 1,6 |
| Installation factors                                                                           |                    |                           |                      |      |                   |     |
| Dry or wet concrete                                                                            |                    | $\gamma_{inst}$           | [-]                  | 1,0  |                   |     |
| Water filled hole                                                                              |                    |                           |                      | „4)  | 1,2 <sup>3)</sup> |     |
| Displacement-Factors for tension load <sup>1)</sup>                                            |                    |                           |                      |      |                   |     |
| $\delta_{N,C2}$ (DLS)-Factor                                                                   |                    | [mm/(N/mm <sup>2</sup> )] | 0,20                 | 0,13 | 0,21              |     |
| $\delta_{N,C2}$ (ULS)-Factor                                                                   |                    |                           | 0,38                 | 0,18 | 0,24              |     |
| Displacement-Factors for shear load <sup>2)</sup>                                              |                    |                           |                      |      |                   |     |
| $\delta_{V,C2}$ (DLS)-Factor                                                                   |                    | [mm/kN]                   | 0,18                 | 0,10 | 0,07              |     |
| $\delta_{V,C2}$ (ULS)-Factor                                                                   |                    |                           | 0,25                 | 0,14 | 0,11              |     |

1) Calculation of effective displacement:

$$\delta_{N,C2} (DLS) = \delta_{N,C2} (DLS)\text{-Factor} \cdot \tau_{Ed}$$

$$\delta_{N,C2} (ULS) = \delta_{N,C2} (ULS)\text{-Factor} \cdot \tau_{Ed}$$

( $\tau_{Ed}$ : Design value of the applied tensile stress)

2) Calculation of effective displacement:

$$\delta_{V,C2} (DLS) = \delta_{V,C2} (DLS)\text{-Factor} \cdot V_{Ed}$$

$$\delta_{V,C2} (ULS) = \delta_{V,C2} (ULS)\text{-Factor} \cdot V_{Ed}$$

( $V_{Ed}$ : Design value of the applied shear force)

<sup>3)</sup> Only with coaxial cartridges: 380ml, 400 ml, 410 ml

<sup>4)</sup> No performance assessed

fischer injection system FIS V

**Performances**

Characteristic values for combined pull-out and concrete failure under seismic action (performance category C2) for fischer anchor rods and standard threaded rods

**Annex C 14**